

Pulaski County Justice Center - Shower Replacement

110 E. Meridian St.
Winamac, IN 46996

LUMINAUT


PROJECT #IN26034

Pulaski County Justice Center - Shower Replacement

ISSUED FOR BID SET November 16, 2026

COPYRIGHT © 2021 LUMINAUT, INC. - 10/30/2026 12:39:50 PM Autodesk Docs://Pulaski County Justice Center_Shower Stall Replacement/IN26034_Pulaski Justice Center_A24.rvt

Location Map

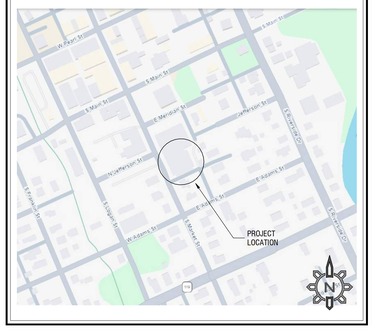


Vicinity Map



Drawing Index

SHEET	DESCRIPTION	BID SET - 11/6/2026			
GENERAL					
G0.00	COVER SHEET	●			
G0.01	GENERAL PROJECT INFORMATION	●			
DEMOLITION					
D1.01	DEMOLITION PLAN	●			
ARCHITECTURE					
A1.01	OVERALL CONSTRUCTION PLAN	●			
PLUMBING AND MECHANICAL					
PM0.01	SYMBOLS, ABBREVIATIONS, & GENERAL NOTES - MECHANICAL	●			
PM02.00	UNDERSLAB PLAN - PULMBING AND MECHANICAL AND MECHANICAL DEMOLITION	●			
PMD2.01	LEVEL 1 FLOOR PLANS - PLUMBING AND MECHANICAL DEMOLITION	●			
PMD2.02	LEVEL 2 FLOOR PLANS - PLUMBING AND MECHANICAL DEMOLITION	●			
PM2.00	UNDERSLAB PLAN - PLUMBING AND MECHANICAL	●			
PM2.01	LEVEL 1 FLOOR PLANS - PLUMBING AND MECHANICAL	●			
PM2.02	LEVEL 2 FLOOR PLANS - PLUMBING	●			
ELECTRICAL					
E0.01	SYMBOLS, ABBREVIATIONS, & GENERAL NOTES - ELECTRICAL	●			
ED2.01	LEVEL 1 FLOOR PLANS - ELECTRICAL DEMOLITION	●			
ED2.02	LEVEL 2 FLOOR PLANS - ELECTRICAL DEMOLITION	●			
E2.01	LEVEL 1 FLOOR PLANS - ELECTRICAL	●			
E2.02	LEVEL 2 FLOOR PLANS - ELECTRICAL	●			

Drawing Symbols Legend

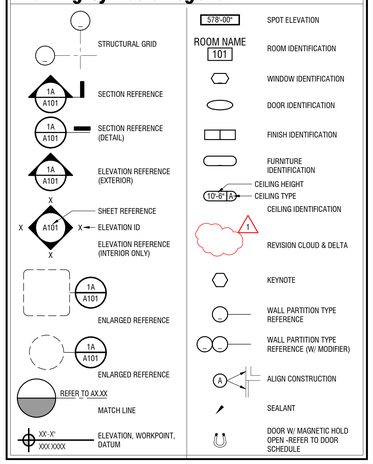

Overall Project Demolition Notes

DM-01.01 DEMOLITION SCOPE
REMOVE EXISTING CONSTRUCTION INDICATED FOR DEMOLITION AND ASSOCIATED MATERIALS REASONABLY REQUIRED TO EXECUTE THE NEW WORK. WHERE ADDITIONAL REMOVAL BEYOND THAT INDICATED IS NECESSARY, NOTIFY THE ARCHITECT PRIOR TO PROCEEDING EXCEPT WHERE IMMEDIATE ACTION IS REQUIRED TO ADDRESS AN EMERGENCY CONDITION.

DM-01.02 PREPARATION FOR NEW WORK
REMOVE EXISTING MATERIALS, FINISHES, FASTENERS, ADHESIVES, AND ASSOCIATED COMPONENTS AS REQUIRED TO PROVIDE SUBSTRATES AND CONDITIONS SUITABLE FOR THE INDICATED NEW WORK.

DM-01.03 DEMOLITION LIMITS
WHERE AN ELEMENT OR FINISH IS INDICATED FOR REMOVAL, REMOVE ASSOCIATED COMPONENTS REASONABLY REQUIRED TO REMOVE THE INDICATED ASSEMBLY AND PREPARE THE AREA FOR NEW WORK, UNLESS OTHERWISE INDICATED.

DM-01.04 SALVAGE AND OWNER ITEMS
SALVAGE ITEMS SPECIFICALLY INDICATED FOR REUSE, REINSTALLATION, OR DELIVERY TO THE OWNER. COORDINATE DESIGNATED STORAGE OR DELIVERY LOCATIONS WITH THE OWNER'S REPRESENTATIVE. DO NOT DISPOSE OF ITEMS IDENTIFIED FOR OWNER RETENTION.

DM-01.05 BUILDING SERVICE INTERRUPTION NOTICE
PROVIDE NOT LESS THAN [48] HOURS' NOTICE TO THE OWNER'S REPRESENTATIVE AND BUILDING ENGINEER PRIOR TO PLANNED INTERRUPTION, DISCONNECTION, OR REMOVAL OF ACTIVE BUILDING SERVICES, UNLESS OTHER NOTICE REQUIREMENTS ARE ESTABLISHED BY THE OWNER.

DM-01.06 MEP AND FIRE-PROTECTION DEMOLITION
COORDINATE DEMOLITION OF MECHANICAL, ELECTRICAL, PLUMBING, FIRE-PROTECTION, COMMUNICATIONS, AND OTHER BUILDING SYSTEMS WITH THE APPLICABLE CONSULTANT DOCUMENTS. WHERE THE REQUIRED TERMINATION, CAP, ABANDONMENT, OR CONTINUATION OF AN EXISTING SERVICE IS NOT INDICATED OR WOULD INTERRUPT A SERVICE INTENDED TO REMAIN, NOTIFY THE APPROPRIATE DESIGN PROFESSIONAL PRIOR TO PROCEEDING.

DM-01.07 FIRE- AND SMOKE-RESISTANT CONSTRUCTION
PATCH OPENINGS AND PENETRATIONS CREATED BY DEMOLITION IN FIRE- OR SMOKE-RESISTANT CONSTRUCTION USING TESTED AND LISTED SYSTEMS APPROPRIATE FOR THE EXISTING CONSTRUCTION AND REQUIRED PERFORMANCE.

DM-01.08 EXISTING LIFE-SAFETY DEVICES
EXISTING FIRE EXTINGUISHERS, DETECTORS, ALARMS, EMERGENCY LIGHTING, SPRINKLERS, AND OTHER LIFE-SAFETY DEVICES INDICATED TO REMAIN SHALL REMAIN IN SERVICE EXCEPT DURING AUTHORIZED INTERRUPTIONS. NEW OR RELOCATED DEVICES SHALL BE AS INDICATED IN THE CONTRACT DOCUMENTS.

DM-01.09 LIGHT FIXTURES TO REMAIN
WHERE EXISTING LIGHT FIXTURES INDICATED TO REMAIN REQUIRE TEMPORARY REMOVAL TO EXECUTE THE WORK, COORDINATE REMOVAL, STORAGE, AND REINSTALLATION WITH THE APPLICABLE CONTRACT DOCUMENTS.

DM-01.10 CASEGOODS, FF&E, AND EQUIPMENT
WHERE CASEGOODS, FF&E, FURNISHINGS, OR EQUIPMENT ARE INDICATED TO REMAIN, BE SALVAGED, RELOCATED, OR REINSTALLED, COORDINATE THEIR DISPOSITION WITH THE OWNER'S REPRESENTATIVE. DO NOT DISPOSE OF OWNER ITEMS WITHOUT OWNER AUTHORIZATION.

Project Team

Owner — Pulaski County
112 East Main Street — Winimac, IN, 46996
www.pulaskionline.org — 574-242-2458

Architect — LUMINAUT
1100 Sycamore Street, Suite 200 — Cincinnati, OH 45202
702 N. Capitol Avenue — Indianapolis, IN 46204
www.luminaut.com — Cin. Ph: 513.984.1070 - Indy. Ph: 317.636.3980

MEP — R.E. Dimond and Associates
732 N. Capitol Avenue — Indianapolis, IN, 46204
www.redimond.com — 317-634-4672

Overall Project Construction Notes

GN-01.01 APPLICABLE REQUIREMENTS
THE WORK SHALL CONFORM TO THE CONTRACT DOCUMENTS AND APPLICABLE LAWS, CODES, ORDINANCES, RULES, AND REGULATIONS OF AUTHORITIES HAVING JURISDICTION. IF THE CONTRACTOR OBSERVES THAT ANY PORTION OF THE CONTRACT DOCUMENTS APPEARS CONTRARY TO APPLICABLE REQUIREMENTS, PROMPTLY NOTIFY THE ARCHITECT AND DO NOT PROCEED WITH THE AFFECTED WORK UNTIL THE DISCREPANCY HAS BEEN ADDRESSED.

GN-01.02 CONTRACT DOCUMENTS
THE DRAWINGS SHALL BE USED IN CONJUNCTION WITH THE PROJECT MANUAL, SPECIFICATIONS, SCHEDULES, FF&E DOCUMENTS, MATERIAL REFERENCES, CONSULTANT DOCUMENTS, AND OTHER DOCUMENTS IDENTIFIED AS CONTRACT DOCUMENTS. REQUIREMENTS INDICATED IN ONE CONTRACT DOCUMENT SHALL BE COORDINATED WITH REQUIREMENTS OF THE OTHERS.

GN-01.03 PRODUCT AND MATERIAL REQUIREMENTS
REFER TO THE APPLICABLE SPECIFICATIONS, SCHEDULES, FF&E DOCUMENTS, MATERIAL REFERENCES, AND CONSULTANT DOCUMENTS FOR MANUFACTURER, PRODUCT, MODEL, STYLE, FINISH, PERFORMANCE, FABRICATION, INSTALLATION, AND ASSIGNED PROCUREMENT OR INSTALLATION RESPONSIBILITIES.

GN-01.04 OWNER'S REPRESENTATIVE
REFERENCES TO THE OWNER OR OWNER'S REPRESENTATIVE SHALL HAVE THE MEANING AND AUTHORITY ESTABLISHED BY THE CONTRACT DOCUMENTS.

GN-01.05 OWNER OPERATIONS AND PHASING
COORDINATE THE WORK WITH OWNER-ESTABLISHED OPERATIONAL REQUIREMENTS INCLUDING WORK HOURS, ACCESS RESTRICTIONS, OCCUPIED AREAS, NOISE AND DISRUPTION LIMITATIONS, UTILITY SHUTDOWN PERIODS, AND OTHER OPERATIONAL CONSTRAINTS. PREPARE AND MAINTAIN CONSTRUCTION PHASING AND SCHEDULING NECESSARY TO COMPLY WITH THESE REQUIREMENTS. SUBMIT REQUESTED PHASING INFORMATION TO THE OWNER'S REPRESENTATIVE FOR REVIEW OF IMPACTS ON PROPERTY OPERATIONS.

GN-01.06 CONSTRUCTION MEANS, METHODS, AND SAFETY
THE CONTRACTOR SHALL BE RESPONSIBLE FOR CONSTRUCTION MEANS, METHODS, TECHNIQUES, SEQUENCES, PROCEDURES, COORDINATION OF THE WORK, AND SAFETY PRECAUTIONS AND PROGRAMS, EXCEPT WHERE SPECIFIC REQUIREMENTS ARE EXPRESSLY INDICATED IN THE CONTRACT DOCUMENTS. ARCHITECT'S REVIEW OR OBSERVATION OF THE WORK SHALL NOT CONSTITUTE CONTROL OVER OR RESPONSIBILITY FOR SUCH MATTERS.

GN-01.07 DO NOT SCALE DRAWINGS
DO NOT SCALE DRAWINGS TO DETERMINE DIMENSIONS. USE WRITTEN DIMENSIONS AND SPECIFICALLY INDICATED LAYOUT INFORMATION. WHERE REQUIRED DIMENSIONS OR LOCATIONS CANNOT BE DETERMINED FROM THE CONTRACT DOCUMENTS, REQUEST CLARIFICATION PRIOR TO PROCEEDING WITH THE AFFECTED WORK.

GN-01.08 DIMENSIONING CONVENTIONS
UNLESS OTHERWISE INDICATED, DIMENSIONS ARE TO FINISH FACE OF GYPSUM BOARD OR OTHER INDICATED FINISH MATERIAL, CENTERLINE OF COLUMNS, FACE OF CONCRETE, EDGE OF SLAB, OR EDGE OF OPENING, AS APPLICABLE.

GN-01.09 COORDINATION
COORDINATE THE WORK OF SUBCONTRACTORS AND SUPPLIERS WITH THE WORK OF OTHER TRADES, THE OWNER, AND OTHERS. COORDINATE INTERFACES BETWEEN WORK OCCURRING PRIOR TO, CONCURRENT WITH, AND SUBSEQUENT TO THE WORK.

GN-01.10 COMPLETE INSTALLATIONS
PROVIDE COMPONENTS AND ACCESSORIES REASONABLY INFERABLE FROM THE CONTRACT DOCUMENTS AND ORDINARILY REQUIRED TO PROVIDE COMPLETE INSTALLATIONS AND ACHIEVE THE INDICATED RESULTS. WORK IDENTIFIED AS BY OTHERS, OWNER FURNISHED, OWNER INSTALLED, OR NOT IN CONTRACT SHALL BE COORDINATED BUT SHALL NOT BECOME CONTRACTOR-PERFORMED WORK UNLESS OTHERWISE REQUIRED BY THE CONTRACT DOCUMENTS.

GN-01.11 DISCREPANCIES AND CONFLICTS
PROMPTLY NOTIFY THE ARCHITECT OF DISCOVERED DISCREPANCIES, CONFLICTS, OMISSIONS, OR INCONSISTENCIES WITHIN THE CONTRACT DOCUMENTS OR BETWEEN THE CONTRACT DOCUMENTS AND CONDITIONS AFFECTING THE WORK. DO NOT PROCEED WITH AFFECTED WORK UNTIL CLARIFICATION HAS BEEN PROVIDED.

GN-01.12 FIELD VERIFICATION
PRIOR TO FABRICATION, ORDERING, OR INSTALLATION, VERIFY DIMENSIONS AND CONDITIONS THAT ARE REASONABLY OBSERVABLE AND AFFECT THE WORK. TAKE FIELD MEASUREMENTS NECESSARY FOR PROPER FABRICATION, FIT, CONNECTION, AND INSTALLATION. PROMPTLY REPORT DISCOVERED CONCEALED OR DIFFERING CONDITIONS AFFECTING THE WORK.

GN-01.13 PERMITS AND INSPECTIONS
OBTAIN PERMITS, LICENSES, FEES, AND INSPECTIONS ASSIGNED TO THE CONTRACTOR BY THE CONTRACT DOCUMENTS. COORDINATE REQUIRED INSPECTIONS WITH AUTHORITIES HAVING JURISDICTION.

GN-01.14 PROTECTION AND CLEANING
PROTECT NEW WORK, MATERIALS, EQUIPMENT, AND CONSTRUCTION UNDER THE CONTRACTOR'S CONTROL. REPAIR OR REPLACE WORK DAMAGED BY CONTRACTOR-CONTROLLED OPERATIONS AS REQUIRED TO RESTORE CONFORMANCE WITH THE CONTRACT DOCUMENTS. REMOVE CONSTRUCTION DEBRIS AND LEAVE AFFECTED WORK AREAS CLEAN UPON COMPLETION.

GN-01.15 INSTALLATION REQUIREMENTS
INSTALL MATERIALS, PRODUCTS, ASSEMBLIES, AND EQUIPMENT IN ACCORDANCE WITH THE CONTRACT DOCUMENTS, APPLICABLE MANUFACTURER'S WRITTEN INSTRUCTIONS, AND SPECIFICALLY REFERENCED INDUSTRY STANDARDS. WHERE THESE REQUIREMENTS CONFLICT, NOTIFY THE ARCHITECT PRIOR TO PROCEEDING WITH THE AFFECTED WORK.

GN-01.16 WORKMANSHIP AND CONFORMANCE
PERFORM THE WORK IN ACCORDANCE WITH THE CONTRACT DOCUMENTS, APPLICABLE MANUFACTURER'S REQUIREMENTS, SPECIFICALLY REFERENCED INDUSTRY STANDARDS, AND RECOGNIZED STANDARDS OF WORKMANSHIP FOR THE RESPECTIVE TRADE. COMPLETED WORK SHALL CONFORM TO THE REQUIREMENTS AND DESIGN INTENT INDICATED IN THE CONTRACT DOCUMENTS.

Abbreviations & Definitions

WHERE ADDITIONAL ABBREVIATIONS OR WORD DEFINITIONS ARE DEFINED BY ANOTHER DISCIPLINE AND A CONFLICT OCCURS, THEIR DEFINITIONS SHALL TAKE PRECEDENCE OVER THE FOLLOWING ON OTHER DISCIPLINES DOCUMENTS **ONLY**. WHERE AN ABBREVIATION IS UNDEFINED - NOTIFY THE ARCHITECT, FOR CLARIFICATION

A/C	AIR CONDITIONING
AB	ANCHOR BOLT
ABV	ABOVE
ACC	ACCESSIBLE
ACM	ALUMINUM COMPOSITE MATERIAL
ACT	ACOUSTICAL CEILING TILE
ADA	AMERICANS WITH DISABILITIES ACT
ADJ	ADJACENT
ADJUST	ADJUSTABLE
AFF or A.F.F.	ABOVE FINISHED FLOOR
AL or ALUM.	ALUMINUM
ALT	ALTERNATIVE
APC	ACOUSTICAL PANEL CEILING (EXPOSED SUSPENSION SYSTEM)
APPROX	APPROXIMATE
ARCH	ARCHITECT(URAL)
ARG	ABUSE RESISTANT GYPSUM
ASF	ABOVE SUBFLOOR
ATC	ACOUSTICAL TILE CEILING (CONCEALED SUSPENSION SYSTEM)
AV	AUDIO/VISUAL
AVG	AVERAGE
B/O	BOTTOM OF
BB	BLIND BASE
BD	BOARD
BLDG	BUILDING
BLKG	BLOCKING
BM	BEAM
BOT	BOTTOM
BRG	BEARING
BS	BACKSPLASH
C.F.	COMMUNICATION FEATURES
C.O.	CASED OPENING
CA	CARPET
CATV	CABLE TELEVISION
CFMF	COLD FORMED METAL FRAMING
CIRC	CIRCLE/CIRCULAR
CJ or C.J.	CONTROL JOINT
CL	CENTERLINE
CLG or CLNG	CEILING
CLO	CLOSET
CLR	CLEAR
CMU	CONCRETE MASONRY UNIT
COL	COLUMN
COMP	COMPACT(ED)
CONC	CONCRETE
CONST	CONSTRUCTION
CONT	CONTINUOUS
CORR	CORRIDOR
CPT	CARPET
CSMU	CALCIUM SILICATE MASONRY UNIT
CT	CERAMIC TILE
CW	CURTAINWALL
D	CLOTHES DRYER
DAFS	DIRECT APPLIED FINISH SYSTEM
DB	DRAWER BASE
DBL	DOUBLE
DEPT	DEPARTMENT
DET/DTL	DETAIL
DF or D.F.	DRINKING FOUNTAIN
DIA	DIAMETER
DIM	DIMENSION
DISP	DISPENSER OR GARBAGE DISPOSAL
DIV	DIVISION
DN	DOWN
DP	DEEP/DEPTH
DR	DOOR
DRN	DRAIN
DRW	DRAWER
DS or D.S.	DOWNSPOUT
DW	DISHWASHER
DWG	DRAWING
EA	EACH
EIFS	EXTERIOR INSULATION FINISH SYSTEM
EJ or E.J.	EXPANSION JOINT
EL	ELEVATION
ELEC	ELECTRIC
ELECT	ELECTRIC
ELEV	ELEVATOR OR ELEVATION
EMERG.	EMERGENCY
ENG	ENGINEER
EQ	EQUAL
EQUIP	EQUIPMENT
EW	EACH WAY
EXH	EXHAUST
EXIST	EXISTING
EXP	EXPANSION
EXT	EXTERIOR
EXTN	EXTENSION
FD or F.D.	FLOOR DRAIN
FDN	FOUNDATION
FE	FIRE EXTINGUISHER
FEC	FIRE EXTINGUISHER CABINET
FF	FINISH FLOOR
FHC	FIRE HOSE CABINET
FIN	FINISH
FIXT	FIXTURE
FL or FLR	FLOOR
FLR	FLOOR
FRC	FIBER REINFORCED CONCRETE
FRG	FIBER REINFORCED GYPSUM
FRP	FIBER REINFORCED POLYMER
FRT	FIRE RETARDANT TREATED
FRZR	FREEZER
FT	FEET/FOOT
FTG	FOOTING
FURN	FURNACE OR FURNITURE
FV or F.V.	FIELD VERIFY
G.B. or GYP	GYPSUM BOARD
GA	GAUGE
GALV	GALVANIZED
GB	GRAB BAR
GC	GENERAL CONTRACTOR
GFRC	GLASS FIBER REINFORCED CONCRETE
GFRG	GLASS FIBER REINFORCED GYPSUM
GL or GLAZ	GLASS OR GLAZING
GMG	GLASS-MAT GYPSUM SHEATHING
GWB	GYPSUM WALL BOARD
H.B.	HOSE BIBB
HC	HOLLOW CORE
HCWD	HOLLOW CORE WOOD DOOR
HDW	HARDWARE
HDWD	HARDWOOD
HGT or HT.	HEIGHT
HM or H.M.	HOLLOW METAL
HMD	HOLLOW METAL DOOR
HORIZ	HORIZONTAL
HR	HOUR
HRDW	HARDWARE
HSS	HOLLOW STEEL SECTION
HT	HEIGHT
HTG	HEATING
HVAC	HEATING/VENTILATION/AIR CONDITIONING
HW	HOT WATER
HWD	HARDWOOD
ID	INSIDE DIAMETER
IIC	IMPACT INSULATION CLASS
IN	INCH
INCL	INCLUDING
INFO	INFORMATION
INSUL	INSULATION
INT	INTERIOR
IRG	IMPACT RESISTANT GYPSUM
JAN	JANITOR (IAL)
JC or J.C.	JANITOR'S CLOSET
JST	JOIST
JT or JNT	JOINT
KIT	KITCHEN
L	LONG/LENGTH
LAM	LAMINATE
LAV	LAVATORY
LB or LBS.	POUND
LGMF	LIGHT GAUGE METAL FRAMING
LL	LIVE LOAD
LLV	LONG LEG VERTICAL
LVL	LAMINATED VENEER LUMBER
M.H.	MAN HOLE
M.R.	MOISTURE RESISTANT
MAG	MAGNETIC
MAS	MASONRY
MATL	MATERIAL
MAX	MAXIMUM
MDF	MEDIUM DENSITY FIBERBOARD
MDO	MEDIUM DENSITY OVERLAY
MECH	MECHANICAL
MEP	MECHANICAL/ ELECTRICAL/PLUMBING
MFR or MFG	MANUFACTURER
MI	MIRROR IMAGE
MIN	MINIMUM
MISC	MISCELLANEOUS
MO	MASONRY OPENING
MTD	MOUNTED
MTL	METAL
MULL	MULLION
MW or MWO	MICROWAVE OVEN
MWO	MICROWAVE OVEN
N/A	NOT APPLICABLE
NIC or N.I.C.	NOT IN CONTRACT
NO	NUMBER
NOM	NOMINAL
NTS or N.T.S.	NOT TO SCALE
O.C.	ON CENTER
O.D.	OUTSIDE DIAMETER
O/A	OVERALL
O/O	OUT TO OUT
OH	OVERHEAD
OPNG	OPENING
OPP	OPPOSITE
OSB	ORIENTED STRAND BOARD
P.L.	PROPERTY LINE OR PLASTIC
PC	PRECAST
PL or PLAM	PLASTIC LAMINATE
PLAS	PLASTIC
PLYWD	PLYWOOD
PNL	PANEL
PSF	POUNDS PER SQUARE FOOT
PSI	POUNDS PER SQUARE INCH
PT	PRESSURE TREATED OR PAINT
PTD	PAINTED
PTN	PARTITION
PVC	POLYVINYLCHLORIDE
PW	PLYWOOD
R	RADIUS OR RISER
R.O.W.	RIGHT OF WAY
RAD	RADIUS OR RADIATOR
RD or R.D.	ROOF DRAIN
REF	REFRIGERATOR
REFER	REFERENCE / REFER TO
REINF	REINFORCE/REINFORCING
REQD	REQUIRED
REV	REVISION / REVISED
RL or R.L.	RAIN LEADER
RM	ROOM
RO or R.O.	ROUGH OPENING
S/R	SHELF/ROD
SB	SINK BASE
SC	SOLID CORE
SCHED	SCHEDULE
SCWD	SOLID CORE WOOD DOOR
SECT	SECTION
SF or S.F.	SQUARE FEET/SQUARE FOOT
SHLV	SHELVES
SHT	SHEET
SHTG	SHEATHING
SIM	SIMILAR
SOG	SLAB ON GRADE
SPEC	SPECIFICATION
SQ	SQUARE
SS or S.S.	STAINLESS STEEL OR SOLID SURFACE
ST	STAIN/STAINED
STC	SOUND TRANSMISSION CLASS
STD	STANDARD
STL	STEEL
STL/STL	STAINLESS STEEL
STOR	STORAGE
STRUCT	STRUCTURAL
SUSP.	SUSPENDED
SW	SWITCH
T	TREAD OR THICK
T&G	TONGUE AND GROOVE
T.O.C.	TOP OF CONCRETE
T.O.F.	TOP OF FOOTING
T.O.M.	TOP OF MASONRY
T.O.S.	TOP OF STEEL
T.O.W.	TOP OF WALL
T/O	TOP OF
TBD	TO BE DETERMINED
TEL	TELEPHONE
TEMP.	TEMPORARY OR TEMPERED
THK	THICK
THRU	THROUGH
TME	TO MATCH EXISTING
TV	TELEVISION
TYP	TYPICAL
U.N.O.	UNLESS NOTED OTHERWISE
UC	UPPER CABINET OR UNDER COUNTER OR UNDER CABINET
UL	UNDERWRITERS LABORATORIES
VB	VAPOR BARRIER OR VINYL BASE
VCT	VINYL COMPOSITION TILE
VERT	VERTICAL
VIF or V.I.F.	VERIFY IN FIELD
VR	VAPOR RETARDER
W	WASHER
W.C.	WATER CLOSET
W.F.	WIDE FLANGE
W.P.	WATERPROOF
W.V.	WATER VALVE
W.W.F.	WELDED WIRE FABRIC
W.W.M.	WELDED WIRE MESH
W/	WITH
W/O	WITHOUT
WD	WOOD
WH	WATER HEATER
WIC	WALK-IN CLOSET OR WALK-IN COOLER
WIF	WALK-IN FREEZER
WIN	WINDOW
WSCT.	WAINSCOT
WT.	WEIGHT
YD	YARD

LUMINAUT
1100 Sycamore Street, Suite 200
Cincinnati, Ohio 45202 - Ph: 513.984.1070
702 N. Capitol Avenue
Indianapolis, Indiana 46204
Ph: 317.636.3980
www.luminaut.com

Project Title
Pulaski County Justice Center - Shower Replacement

110 E. Meridian St.
Winamac, IN 46996

Issue Date:
November 16, 2026

Issued for:
ISSUED FOR BID SET

Revision
1

Sheet Title
GENERAL PROJECT INFORMATION

Project No.
IN26034

Drawn By: Author
Reviewed By: Checker
Scale: 12" = 1'-0"

G0.01

COPYRIGHT © 2023 LUMINAUT, INC. - 10/20/2026 12:59:06 PM J:\Autodesk Docs_Pulaski County Justice Center_Shower Stall Replacement\IN26034_Pulaski Justice Center_ASA.rvt



1L **DEMO PHOTO**
D1.01 12" = 1'-0" | LEVEL-2 SHOWER



4L **DEMO PHOTO**
D1.01 12" = 1'-0" | LEVEL-2 DRY-OFF AREA (CEILING)



8K **DEMO PHOTO**
D1.01 12" = 1'-0" | LEVEL-1 SHOWER STALL



11K **DEMO PHOTO**
D1.01 12" = 1'-0" | LEVEL-1 DRY-OFF AREA



14K **DEMO PHOTO**
D1.01 NOT TO SCALE | UTILITY CHASE




1E **DEMO PHOTO**
D1.01 NOT TO SCALE | LEVEL-2 SHOWER ENTRY




1A **DEMO PHOTO**
D1.01 12" = 1'-0" | LEVEL-1 SHOWER ENTRY



4G **DEMO PHOTO**
D1.01 12" = 1'-0" | UTILITY CHASE

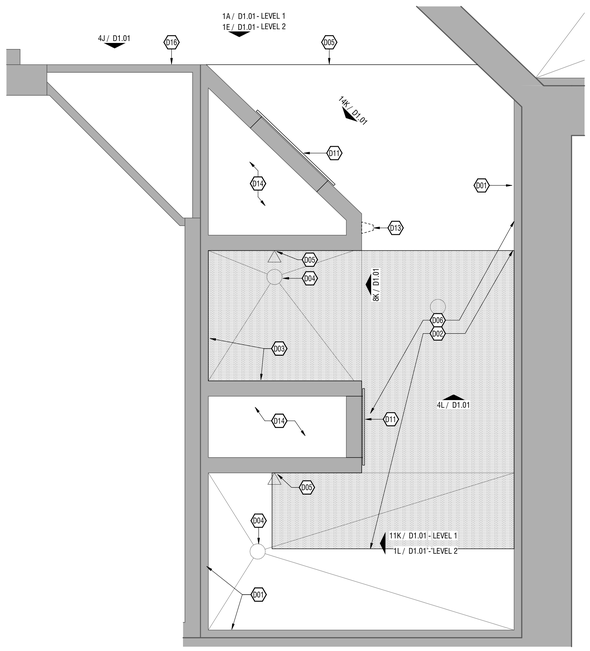

4A **ENLARGED DEMOLITION PLAN**
D1.01 3/4" = 1'-0" | LEVEL-1 (LEVEL-2 Sim. - Except Flooring)

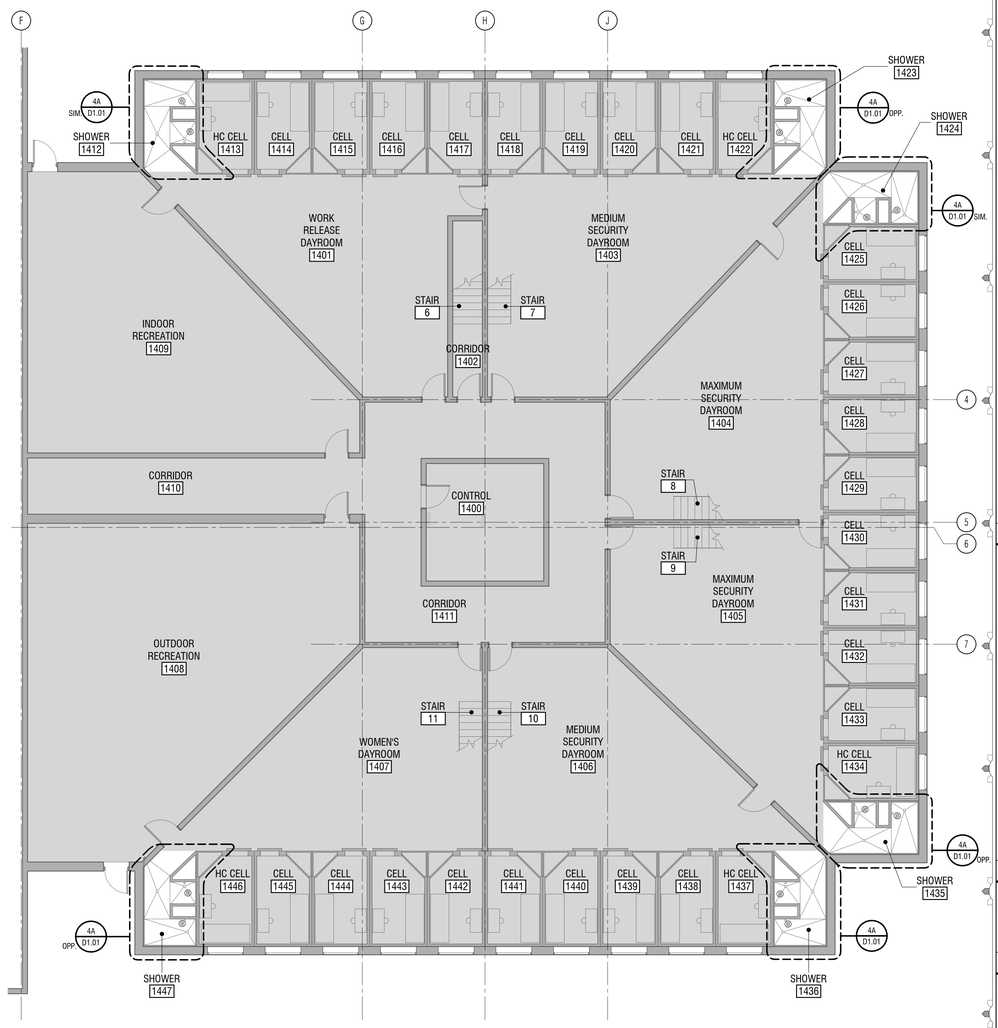

8A **OVERALL DEMOLITION PLAN - LEVEL 1**
D1.01 1/8" = 1'-0"

KEYNOTES:

D01 REMOVE EXISTING STEEL SHOWER POD DETENTION CELL WALL PANELS -- REFER TO SPECIFICATIONS FOR ADDITIONAL INFORMATION
D02 DEMOLISH EXISTING CONCRETE SLAB AT FIRST FLOOR IN COORDINATION WITH PLUMBING DWGS. REMOVE MINIMAL AMOUNT OF CONCRETE IN ORDER TO REMOVE EXISTING PLUMBING LINES.
D03 REMOVE ALL GRAB BARS AND ASSOCIATED FASTENERS
D04 EXISTING FLOOR DRAINS TO BE REMOVED -- REFER TO SPECIFICATIONS FOR ADDITIONAL INFORMATION
D05 ALTERNATE #1 - BASE BID: REMOVE BUTTON CONTROLLING SHOWER AT METAL PANEL AND SALVAGE
D06 REMOVE EXISTING STEEL PAN FLOORING OF SHOWER PODS AT SECOND FLOOR -- REFER TO SPECIFICATIONS FOR ADDITIONAL INFORMATION
D07 REMOVE EXISTING SHOWER HEADS -- REFER TO SPECIFICATIONS FOR ADDITIONAL INFORMATION
D08 REMOVE EXISTING SHELF AND TOWEL/GARMENT HOOK
D10 REMOVE EXISTING LIGHT FIXTURES AND REPLACE WITH NEW -- CONTRACTOR SHALL ADDRESS ANY ADDITIONAL DAMAGED CONDITIONS BEYOND LIGHT FIXTURE
D11 UTILITIES ACCESS PANEL -- REPLACE DAMAGED PANELS -- SALVAGE HINGE AND LOCK IF POSSIBLE -- REFER TO SPECIFICATIONS FOR ADDITIONAL INFORMATION
D12 REMOVE EXISTING CEILING SPEAKER
D13 EXISTING TAMPER-PROOF SPRINKLER HEAD - REMOVE AND REPLACE HEAD
D14 SHOWER UTILITIES CHASE -- WALL PANELS TO BE REMOVED -- REFER TO MECHANICAL AND ELECTRICAL DWGS FOR SCOPE OF WORK FOR EACH DISCIPLINE
D15 REMOVE EXISTING STEEL SHOWER PAN AT 2ND FLOORS -- REFER TO SPECIFICATIONS FOR ADDITIONAL INFORMATION
D16 REMOVE EXISTING PANEL AND THRESHOLD WHERE RUST IS PRESENT AT HC UTILITY CLOSETS ADJACENT TO SHOWERS FOR RUST MITIGATION.

GENERAL NOTES:


A. INDIVIDUAL ITEMS ARE ONLY IDENTIFIED FOR CLARITY. IT IS THE CONTRACTOR'S RESPONSIBILITY TO VISIT THE SITE AND UNDERSTAND THE MATERIALITY OF ELEMENTS BEING REMOVED SUCH AS WALLS, FLOORING, CEILINGS, DOORS, ETC.

B. COORDINATE WITH OWNER FOR ROUTING OF ALL HOSES, CABLES, ETC. REQUIRED FOR DEMOLITION AND RESTORATION WORK TO MAINTAIN SECURITY AND LIMIT IMPACT TO TYPICAL OPERATIONS.

DRAWING LEGEND:

- HATCHED WALL INDICATES EXISTING WALLS TO REMAIN
- SHADED AREA INDICATES NO SCOPE
- DASHED LINE INDICATES DEMOLITION
- STIPPLED SLAB INDICATES DEMOLITION

KEY PLAN:



LUMINAUT
1100 Sycamore Street, Suite 200
Cincinnati, Ohio 45202 - Ph: 513.984.1070
702 N. Capitol Avenue
Indianapolis, Indiana 46204
Ph: 317.636.3980
www.luminaut.com

Project Title
Pulaski County Justice Center - Shower Replacement

110 E. Meridian St.
Winamac, IN 46996


Issue Date: November 16, 2026
Issued for: ISSUED FOR BID SET
Revision 1

Sheet Title
DEMOLITION PLAN

Project No. **IN26034**
Drawn By: Author
Reviewed By: Checker
Scale: As indicated


D1.01

COPYRIGHT © 2023 LUMINAUT, INC. - 11/17/2026 10:41:08 AM Autodesk Docs://Pulaski County Justice Center - Shower Stall Replacement/IN26034 - Pulaski Justice Center_A24.rvt

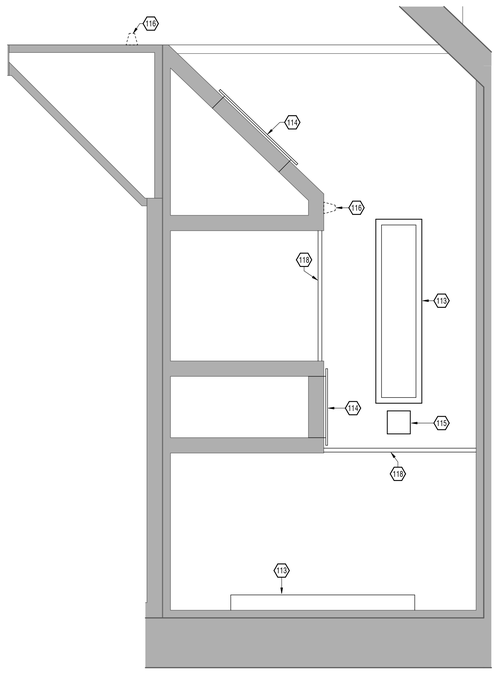


5H / A1.01 ENLARGED CEILING PLAN - TYP. SHOWER STALL

3/4" = 1'-0"

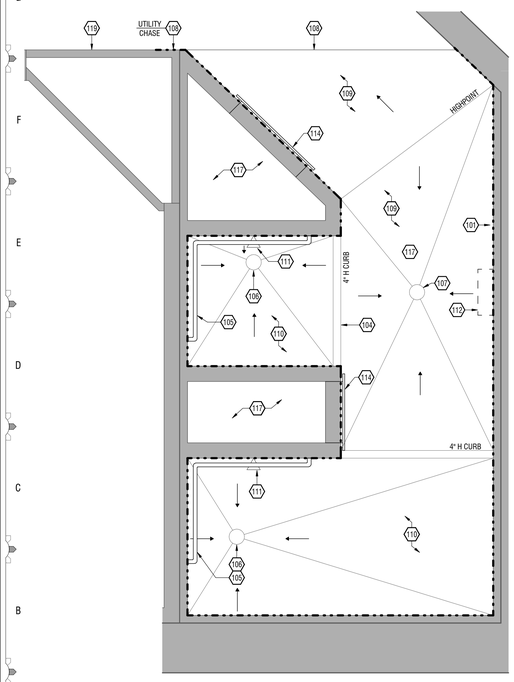


1A / A1.01 ENLARGED PLAN - TYP. SHOWER (LEVEL-2)

3/4" = 1'-0"

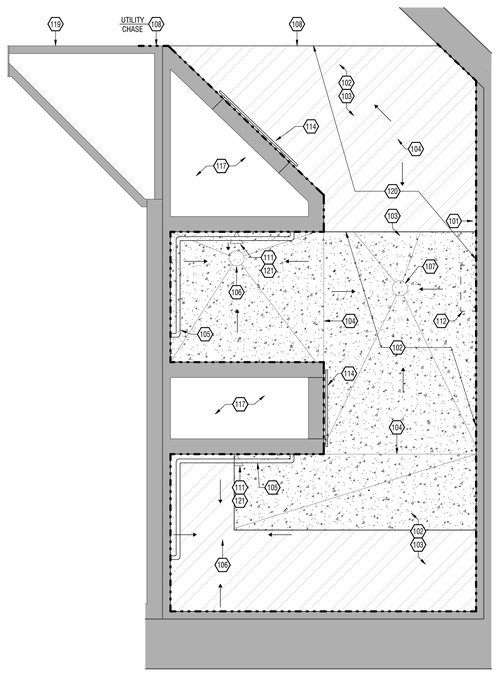

5A / A1.01 ENLARGED PLAN - TYP. SHOWER (LEVEL-1)

3/4" = 1'-0"

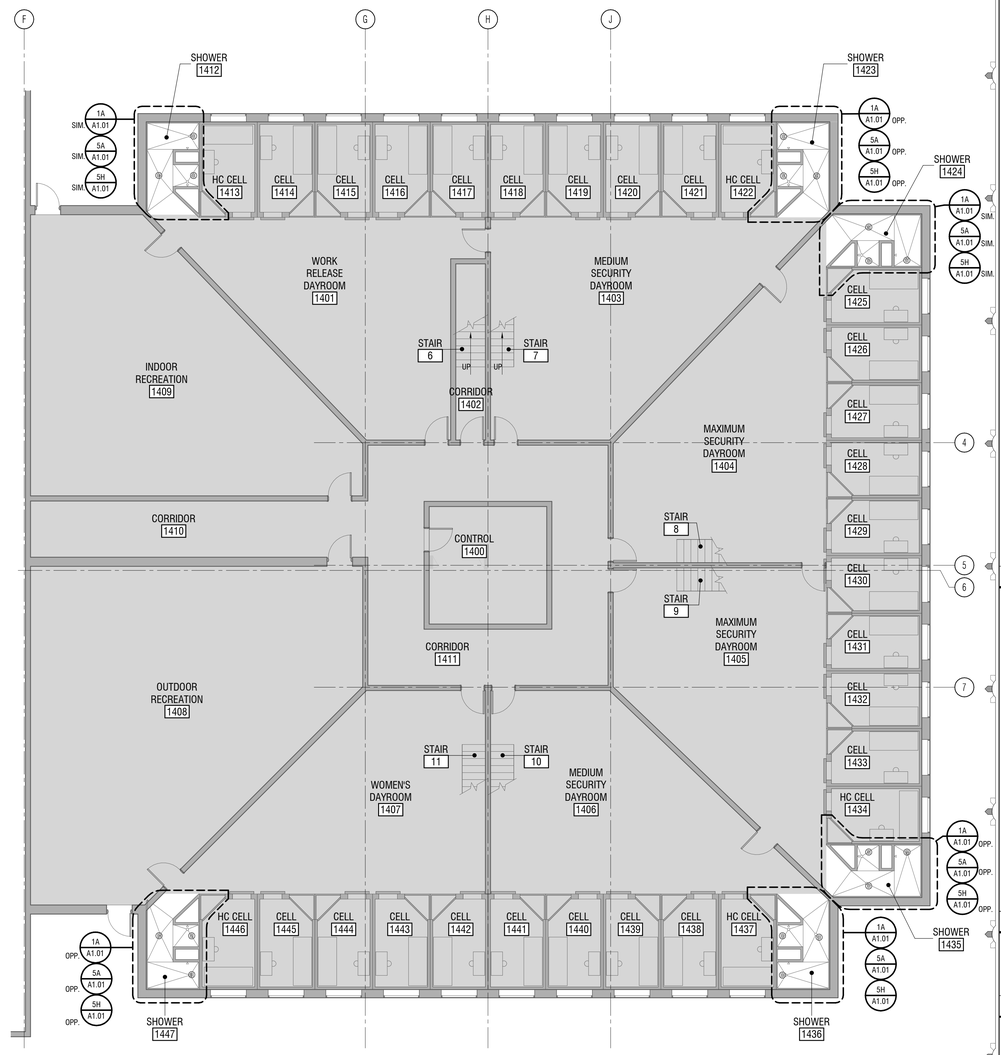

7A / A1.01 CONSTRUCTION PLAN - LEVEL-1 (LEVEL-2 Sim.)

1/8" = 1'-0"

KEYNOTES:

101 PROVIDES STEEL SHOWER POD DETENTION CELL WALL PANELS AT DASHED LINE -- REFER TO SPECIFICATIONS FOR ADDITIONAL INFORMATION
102 PROVIDE 5" CONCRETE SLAB OVER POLYETHYLENE VAPOR BARRIER ON GRANULATED FILL IN COORDINATION WITH PLUMBING DWGS. SEE PLUMBING FOR NEW CONCRETE DETAIL.
103 PROVIDE BUILD-UP FLOORING TOPPING TO ALLOW POSITIVE DRAINAGE TO FLOOR DRAINS AS INDICATED.
104 INDICATES HIGH POINT OF FLOOR BUILD UP OF 1" MAX.
105 PROVIDE NEW GRAB BARS AT ALL SHOWER STALLS. MOUNTING HEIGHT 35" FROM FINISHED FLOOR TO T/ OF GRIPPING SURFACE.
106 NEW FLOOR DRAINS - CONNECT TO EXISTING WASTE LINE -- REFER TO PLUMBING
107 NEW FLOOR DRAIN BUILT INTO METAL SHOWER PAN -- CONNECT TO EXISTING WASTE LINE -- REFER TO PLUMBING
108 INDICATES EXTENT OF PREFABRICATED MODULAR SHOWER POD UNIT REPLACEMENT WITHIN SCOPE OF THIS RENOVATION
109 PROVIDE STEEL FLOOR PANS TO PROVIDE A POSITIVE SLOPE TO DRAIN AS INDICATED -- REFER TO SPECIFICATIONS FOR ADDITIONAL INFORMATION
110 PROVIDE STEEL SHOWER PAN W/ DRAIN - PROVIDE A MIN. 4"H CURB AT SHOWER PAN ENTRY -- REFER TO SPECIFICATIONS FOR ADDITIONAL INFORMATION
111 NEW SHOWER HEAD -- REFER TO PLUMBING DRAWINGS
112 NEW SHELF AND TOWEL /GARMENT HOOK
113 INSTALL OWNER PROVIDED LIGHT FIXTURES TO REPLACE EXISTING - CONFIRM QUANTITIES AND LOCATIONS WITH OWNER
114 SHOWER UTILITIES ACCESS DOOR -- REUSE REFURBISHED HINGES AND LOCKS IF POSSIBLE
115 ADD-ALTERNATE #3: NEW CEILING SPEAKER -- CONNECT TO EXISTING WIRING -- REFER TO ELECTRICAL DRAWINGS
116 NEW TAMPER-PROOF SPRINKLER HEAD -- REFER TO PLUMBING DRAWINGS
117 SHOWER UTILITIES CHASE - INVESTIGATE EXISTING CONDUIT TO CONFIRM IF ANY REPAIR/REPLACEMENT IS REQUIRED -- COORDINATE ALL WORK IN THESE AREAS WITH OWNER PRIOR TO COMMENCING WORK
118 NEW SHOWER CURTAIN AND TRACK.
119 RUST MITIGATION OF STEEL PANELS AT BASE OF HOLDING CELL UTILITY CLOSET UP TO TWO - 48"X96" SHEETS OF STEEL PER SHOWER STALL LOCATION
120 ADD-ALTERNATE #2: NON-SLIP FLOOR COATING AT SHOWER STALL CONCRETE, BOTH EXISTING AND NEW.
121 ADD-ALTERNATE #1: BASE BID: REINSTALL SALVAGED BUTTON IN NEW METAL PANEL AND RECONNECT TO EXISTING SYSTEM ADD ALT: INSTALL NEW BUTTON AND CONNECT TO NEW CONTROL SYSTEM


GENERAL NOTES:

A. AFTER COMPLETION OF DEMOLITION, METAL PANEL MANUFACTURER TO VERIFY ALL EXISTING CONDITIONS IN FIELD PRIOR TO PRODUCTION OF SHOP DRAWINGS.
B. SEAL ALL JOINTS AND GAPS THROUGHOUT WORK AREA. REFER TO DIV 7 JOINT SEALANT SPECIFICATIONS.

DRAWING LEGEND:

HATCHED WALL INDICATES EXISTING WALLS TO REMAIN
SHADED AREA INDICATES NO SCOPE
HATCHED AREA INDICATES NEW CONCRETE SLAB

KEY PLAN:



LUMINAUT
1100 Sycamore Street, Suite 200
Cincinnati, Ohio 45202 - Ph: 513.984.1070
702 N. Capitol Avenue
Indianapolis, Indiana 46204
Ph: 317.636.3980
www.luminaut.com

Project Title

Pulaski County Justice Center - Shower Replacement

110 E. Meridian St.
Winamac, IN 46996

Issue Date: November 16, 2026

Issued for: ISSUED FOR BID SET

Revision
2

Sheet Title
OVERALL CONSTRUCTION PLAN

Project No. IN26034

Drawn By: Author
Reviewed By: Checker
Scale: As indicated

A1.01

COPYRIGHT © 2026 LUMINAUT, INC. - 11/12/2025 2:37:22 PM - Autodesk Docs://Pulaski County Justice Center - Shower Stall Replacement/IN26034 - Pulaski Justice Center_A24.rvt

PLUMBING

- COLD WATER
- HOT WATER
- HOT WATER RETURN
- HOT WATER (140° F)
- HOT WATER RETURN (140° F)
- HOT WATER (180° F)
- HOT WATER RETURN (180° F)
- T — TEMPERED WATER
- CSW — COLD SOFT WATER
- HSW — HOT SOFT WATER
- HSWR — HOT SOFT WATER RETURN
- NPW — NON-POTABLE WATER
- G — GAS
- A — AIR (WITH PSI)
- I — STORM WATER (SUSPENDED)
- I — STORM WATER (BURIED)
- II — SANITARY WASTE (SUSPENDED)
- II — SANITARY WASTE (BURIED)
- III — ACID WASTE (SUSPENDED)
- III — ACID WASTE (BURIED)
- SANITARY VENT LINE
- GW — GREASE WASTE
- D — DRAIN LINE
- WW — WELL WATER
- GM — GAS METER
- WM — WATER METER
- RPBP (REDUCED PRESSURE BACKFLOW PREVENTER) RPZ (REDUCED PRESSURE ZONE)
- AIR CHAMBER
- SHOCK ABSORBER

PIPE FITTINGS

- ELBOW UP
- ELBOW DOWN
- TEE UP
- TEE DOWN
- CONCENTRIC REDUCER
- ECCENTRICAL REDUCER
- END CAP
- UNION
- STRAINER
- FLANGED CONNECTION
- FLOW ARROW
- PIPE ANCHOR
- EXPANSION JOINT
- PIPE SLEEVE
- PIPE ALIGNMENT GUIDES
- FLEX CONNECTOR
- PIPE PITCH ARROW (DOWN IN ARROW DIRECTION)
- PRESSURE GAUGE
- AUTOMATIC AIR VENT
- COMPOUND GAUGE
- ELBOW
- TEE
- CO — CLEANOUT
- FD — FLOOR DRAIN
- T — THERMOMETER

STEAM PIPING

- BFW — BOILER FEED WATER
- EBFW — EMERGENCY BOILER FEED WATER
- LPS — LOW PRESSURE STEAM
- MPS — MEDIUM PRESSURE STEAM
- HPS — HIGH PRESSURE STEAM
- LPR — LOW PRESSURE CONDENSATE RETURN
- MPR — MEDIUM PRESSURE CONDENSATEE RETURN
- HPR — HIGH PRESSURE CONDENSATE RETURN
- PD — CONDENSATE PUMP DISCHARGE
- CR — CONDENSATE RETURN
- FAT — FLOAT & THERMOSTATIC TRAP
- IB — INVERTED BUCKET TRAP
- T — THERMOSTATIC TRAP

HVAC PIPING

- CS — CONDENSER WATER SUPPLY
- CR — CONDENSER WATER RETURN
- CHWS — CHILLED WATER SUPPLY
- CHWR — CHILLED WATER RETURN
- GS — GROUND LOOP WATER SUPPLY
- GR — GROUND LOOP WATER RETURN
- HPLS — HEAT PUMP LOOP SUPPLY
- HPLR — HEAT PUMP LOOP RETURN
- HS — HEATING WATER SUPPLY
- HR — HEATING WATER RETURN
- FOS — FUEL OIL SUPPLY
- FOR — FUEL OIL RETURN
- FOV — FUEL OIL VENT
- RD — REFRIGERANT DISCHARGE
- RS — REFRIGERANT SUCTION
- RL — REFRIGERANT LIQUID
- RHG — REFRIGERANT HOT GAS
- DTS — DUAL TEMPERATURE SUPPLY
- DTR — DUAL TEMPERATURE RETURN
- CD — CONDENSATE DRAIN

VALVES

- SHUT-OFF VALVE - BUTTERFLY VALVE
- SHUT-OFF VALVE - BALL VALVE
- VERTICAL SHUT-OFF / IN VERTICAL PIPE
- BALANCING VALVE
- CHECK VALVE
- PRESSURE REDUCING VALVE
- MAKE-UP WATER VALVE
- FCV — FLOW CONTROL VALVE
- SAFETY / PRESSURE RELIEF VALVE
- TEMPERATURE / PRESSURE RELIEF VALVE
- CONTROL VALVE (TCV)
- 3-WAY CONTROL VALVE
- THROTTLING VALVE

REFRIGERATION VALVES/FITTINGS

- FD — FILTER-DRYER
- SG — SIGHT GLASS
- CHARGING VALVE
- EVAPORATOR PRESSURE REGULATOR
- MANUAL REFRIGERATION VALVE
- THERMOSTATIC EXPANSION VALVE

RADIATION SYMBOLS

- FINNED TUBE RADIATION
- FINNED TUBE RADIATION IN COVER
- BARE PIPE IN COVER
- RADIATION COVER ONLY

DUCT SYMBOLS


- VOLUME DAMPER
- SUPPLY DUCT UP
- RETURN OR EXHAUST DUCT UP
- SUPPLY DUCT DOWN
- RETURN OR EXHAUST DUCT DOWN
- INTERNAL LINED DUCT
- FD — FIRE DAMPER (FD) IN DUCT
- FSD — COMBINATION FIRE/SMOKE DAMPER (FSD) IN DUCT
- SD — SMOKE DAMPER (SD) IN DUCT
- AP — ACCESS PANEL

FIRE PROTECTION SYSTEM


- PENDANT SPRINKLER HEAD
- UPRIGHT SPRINKLER HEAD
- CONCEALED SPRINKLER HEAD
- F — FIRE PROTECTION PIPING
- DS — DRY STANDPIPE
- DP — DRY PIPE SPRINKLER PIPING
- PA — PRE-ACTION SPRINKLER PIPING
- WP — WET FIRE PROTECTION PIPING
- FIRE HYDRANT
- SIAMESE HOSE CONNECTION
- PIV — POST INDICATOR VALVE
- TS — TAMPER SWITCH
- FS — FLOW SWITCH

NOMENCLATURE FOR SCHEDULED DEVICES


(SEE SCHEUDLES M600 SERIES DRAWINGS FOR ADDITIONAL INFORMATION)




FAN COIL



AIR HANDLING UNIT



FAN




VARIABLE AIR VOLUME BOX


TEMPERATURE CONTROL/MONITORING


- T_H — ROOM THERMOSTAT (HEAT)
- $T_{H,C}$ — ROOM THERMOSTAT (HEAT/COOL)
- T_C — ROOM THERMOSTAT (COOL)
- T — DUCT THERMOSTAT
- H — HUMIDISTAT
- C — CARBON DIOXIDE SENSOR
- FS — FLOW SWITCH
- T — TEMPERATURE SENSOR
- FM — FLOW METER
- M — MOTORIZED DAMPER
- DPT — DIFFERENTIAL PRESSURE TRANSMITTER
- PETE'S PLUG
- VFD — VARIABLE FREQUENCY DRIVE
- TCP — TEMPERATURE CONTROL PANEL

DRAWING NOTATIONS




SECTIONS AND DETAILS





RETURN GRILLE FOR RETURN AIR PLENUM CEILING





SUPPLY DIFFUSER



EXHAUST/RETURN GRILLE



DOUBLE DEFLECTION SUPPLY REGISTER

ABBREVIATIONS

AD	AREA DRAIN
AFC	AUTOMATIC FLOW CONTROL
AFF	ABOVE FINISHED FLOOR
AHR	AIR HOSE REEL
AHU	AIR HANDLING UNIT
ALT	ALTERNATE
AP	ACCESS PANEL
AS	AIR SEPARATOR
BD	BLOWDOWN
BDD	BACKDRAFT/PRESSURE RELIEF DAMPER
BTU	BRITISH THERMAL UNIT
BV	BALANCE VALVE
CB	CATCH BASIN
CI	CAST IRON
CL	CENTERLINE
CO	CLEANOUT
CF	CLOSET FLANGE
COND	CONDENSATE
CONV	HYDRONIC CONVECTOR
CUH	CABINET UNIT HEATER
CW	COLD WATER
DB	DRY BULB
DF	DRINKING FOUNTAIN
DIA	DIAMETER
DIFF	DIFFUSER
DS	DOWNSPOUT
DXC	DIRECT EXPANSION COOLING COIL
EA	EXHAUST AIR
EAT	ENTERING AIR TEMPERATURE
EBBR	ELECTRIC BASEBOARD RADIATION
EC	ELECTRICAL CONCTRACTOR
EG	EXHAUST GRILLE
ECONV	ELECTRIC CONVECTOR
ECUH	ELECTRIC CABINET UNIT HEATER
EF	EXHAUST FAN
ELEC	ELECTRICAL
ELEV	ELEVATION
EOM	END OF MAIN DRIP
EPUH	ELECTRIC PROPELLER UNIT HEATER
ERCP	ELECTRIC RADIANT CEILING PANEL
ERV	ENERGY RECOVERY VENTILATOR
ESP	EXTERNAL STATIC PRESSURE
EWC	ELECTRIC WATER COOLER
EWH	ELECTRIC WATER HEATER
EXPT	EXPANSION TANK
E.	EXISTING
ETR	EXISTING TO REMAIN
FD	FLOOR DRAIN OR FIRE DAMPER
FS	FLOOR SINK
FPVAV	FAN POWERED VAV
FOB	FLAT ON BOTTOM
FSD	COMBINATION FIRE/SMOKE DAMPER
FTR	HYDRONIC FINNED TUBE RADIATION
GC	GENERAL CONTRACTOR
GEN	GENERAL
GFMAU	GAS-FIRED MAKE-UP AIR UNIT
GFPUH	GAS-FIRED PROPELLER UNIT HEATER
HB	HOSE BIBB
HCD	HIGH CAPACITY DRUM LOUVER
HTG	HEATING
HW	HOT WATER
HWR	HOT WATER RETURN
HYD	WALL HYDRANT
ID	INTERNAL DIAMETER
INV. EL.	INVERTED ELEVATION
LAT	LEAVING AIR TEMPERATURE
LBG	LINEAR BAR GRILLE
LBRG	LINEAR BAR RETURN GRILLE
LAV	LAVATORY
MAU	MAKE-UP AIR UNIT
MBH	1000 BTU/HOUR
MECH	MECHANICAL
MH	MANHOLE
MC	MECHANICAL CONTRACTOR
MS	MOP SINK
MUV	AUTOMATIC MAKE-UP VALVE
NC	NORMALLY CLOSED
NO	NORMALLY OPEN
OA	OUTSIDE AIR
OAD	OUTSIDE AIR DAMPER
OBD	OPPOSED BLADE DAMPER
OD	OUTSIDE DIAMETER
ORD	OVERFLOW ROOF DRAIN
OSD	OPEN SITE DRAIN
PFHX	PLATE AND FRAME HEAT EXCHANGER
PIV	POST INDICATOR VALVE
PLBG	PLUMBING
PRV	PRESSURE REDUCING VALVE
PUH	PROPELLER UNIT HEATER
RA	RETURN AIR
RAD	RETURN AIR DAMPER
RCP	HYDRONIC RADIANT CEILING HEATING PANEL
RCNP	REINFORCED CONCRETE PIPE
RD	ROOF DRAIN
RECIRC	RECIRCULATING
RG	RETURN GRILLE
RPZ	REDUCED PRESSURE BACKFLOW PREVENTER
RR	RETURN REGISTER
RIV	ROOF INTAKE VENT
RRV	ROOF RELIEF VENT
SA	SUPPLY AIR
SAN	SANITARY
SD	SMOKE DAMPER
SG	SUPPLY GRILLE
SHDR	SHOWER DRAIN
SK	SINK
SR	SUPPLY REGISTER
SS	STAINLESS STEEL
STHX	SHELL AND TUBE HEAT EXCHANGER
TCC	TEMPERATURE CONTROL CONTRACTOR
TCP	TEMPERATURE CONTROL PANEL
TG	TRANSFER GRILLE
TO	TRANSFER OPENING
TP	TRAP PRIMER LINE
TYP	TYPICAL
UR	URINAL
VAV	VARIABLE AIR VOLUME
VCP	VETRIFIED CLAY PIPE
VD	VOLUME DAMPER
VFD	VARIABLE FREQUENCY DRIVE
VS	VENT STACK
VSD	VARIABLE SPEED DRIVE
VTR	VENT THROUGH ROOF
W	WASTE
WB	WET BULB
WC	WATER CLOSET
WS	WASTE STACK

GENERAL NOTES

1. THESE NOTES APPLY TO EACH AND EVERY 'M', 'P' AND 'FP' SERIES DRAWINGS.
2. ALL NEW WORK IS DRAWN DARK. ALL WORK DRAWN LIGHT AND FOLLOWED BY (E.) IS EXISTING.
3. ALL WORK SHALL REMAIN UNLESS SPECIFICALLY NOTED OTHERWISE.
4. FIELD VERIFY ALL EXISTING CONDITIONS AS TO EXACT SERVICE, LOCATION, TYPE OF MATERIAL, ETC. BEFORE BIDDING AND BEFORE BEGINNING RENOVATION WORK.
5. COORDINATE ALL SHUT-DOWNS, DELIVERY, AND STORAGE OF MATERIALS, ETC. WITH OWNER'S REPRESENTATIVE.
6. CONTRACTOR SHALL BE RESPONSIBLE FOR COORDINATING WORK WITH ALL OTHER TRADES. SEE SPECIFICATION FOR ADDITIONAL REQUIREMENTS RELATED TO COORDINATION.
7. CONTRACTORS SHALL PROTECT ALL EXISTING OWNER FACILITIES DURING CONSTRUCTION. ANY AND ALL OWNER FACILITIES DAMAGED OR DISCONNECTED BY CONTRACTOR OPERATIONS SHALL BE FULLY RESTORED TO PREVIOUS OPERATING AND APPEARANCE CONDITION BY CONTRACTOR.
8. PROVIDE SLEEVES FOR ALL PIPING AND DUCTWORK THAT PENETRATE WALLS, WHETHER SHOWN OR NOT. HOLES THROUGH EXISTING WALLS TO BE CORE DRILLED OR DRILLED WITH HOLE SAW. SEE SPECIFICATIONS.
9. SMOKING, ALCOHOL, DRUGS, WEAPONS, AND CONTRABAND ARE STRICTLY FORBIDDEN ON JOB SITE PROPERTY.
10. CONTRACTOR SHALL BE RESPONSIBLE FOR CORE DRILLING AND CUTTING HOLES THROUGH WALLS AND FLOORS AS REQUIRED TO INSTALL NEW PIPING AND DUCTWORK, WHETHER SHOWN OR NOT UNLESS SPECIFICALLY NOTED ON 'S' SERIES DRAWINGS.
11. FIELD VERIFY EXACT SIZES OF EXISTING PIPING AND DUCTWORK SYSTEMS SHOWN TO BE CONNECTED TO NEW WORK. IN THE EVENT ACTUAL SIZE IS DIFFERENT THAN SHOWN ON DRAWINGS, CONTACT ENGINEER FOR DIRECTION PRIOR TO ANY WORK.
12. DO NOT INSTALL DEVICES WHICH REQUIRE SERVICE BEHIND WALLS OR PLASTER CEILINGS OR BAR JOISTS.
13. ACCESS PANELS ARE REQUIRED IN HARD CEILINGS WHETHER SHOWN OR NOT WHEREVER ACCESS IS REQUIRED TO INSTALL OR SERVICE EQUIPMENT. COORDINATE LOCATIONS WITH REFLECTED CEILING PLANS.
14. IF ACCESS PANELS ARE NEEDED, PROVIDE PANELS WITH HINGES AND KEYED TO THE BUILDING MASTER KEY SYSTEM. DO NOT USE CLOSURE SCREWS.
15. DO NOT RUN ANY UTILITIES, DUCTWORK, PIPING OR EQUIPMENT ABOVE TELECOMMUNICATIONS ROOMS OR ELEVATOR EQUIPMENT ROOMS. CONTACT ENGINEER IF SUCH A CONDITION IS REALIZED, PRIOR TO INSTALLATION.
16. ALL PLUMBING AND MECHANICAL PIPING AND INSULATION MATERIALS INSTALLED IN CEILING RETURN AIR PLENUMS SHALL COMPLY WITH ASTM E84 FOR FLAME-SPREAD RATING OF 25 OR LESS AND SMOKE-DEVELOPED RATING OF 50 OR LESS.
17. ADDITIONAL GENERAL NOTES SPECIFIC TO A PARTICULAR DRAWING ARE NOTED ON THOSE DRAWINGS.
18. SEE 'A' SERIES DRAWINGS FOR WALL AND CEILING REMOVAL AND REPLACEMENT TO INSTALL DUCTWORK, EQUIPMENT, AND PIPING. IF MORE WALL OR CEILING REMOVAL IS REQUIRED THAN SHOWN ON 'A' SERIES DRAWINGS, THEN CONTRACTOR REQUIRING THE DEMOLITION SHALL BE RESPONSIBLE FOR WALL/CEILING REMOVAL AND REPLACEMENT.
19. FOR WALLS THAT GO TO DECK, REFERENCE THE 'A' SERIES DRAWINGS. CONTRACTOR SHALL PROVIDE ACOUSTIC SEALANT AROUND ALL DUCT AND PIPE PENETRATIONS THROUGH FULL HEIGHT WALLS.
20. SEE 'S' SERIES DRAWINGS FOR TYPICAL LINTEL INSTALLATION. MECHANICAL CONTRACTOR IS RESPONSIBLE FOR LINTELS FOR ALL DUCT PENETRATIONS THRU EXISTING WALLS.
21. ACCESS PANELS ARE REQUIRED IN HARD CEILINGS WHEREVER ACCESS IS REQUIRED TO INSTALL OR SERVICE MECHANICAL EQUIPMENT. SEE 'A' SERIES DRAWINGS AND SPECIFICATIONS. COORDINATE LOCATION WITH REFLECTED CEILING PLAN.

LUMINAUT
1100 Sycamore Street, Suite 200
Cincinnati, Ohio 45202 - Ph: 513.984.1070
—
702 N. Capitol Avenue
Indianapolis, Indiana 46204
Ph: 317.636.3980
—
www.luminaut.com

D&A #26069
R.E. Dimond and Associates, Inc.
Consulting Engineers
732 North Capitol Avenue
Indianapolis, IN 46204
Phone: (317) 634-4672
Fax: (317) 638-8725

Project Title

Pulaski County Justice Center - Shower Replacement

110 E. Meridian St.
Winamac, IN 46996

ALEXANDER MICHAEL BELL — REGISTERED — No. 12400523 — STATE OF INDIANA — PROFESSIONAL ENGINEER
11/16/2026

Issue Date: November 16, 2026

Issued for: ISSUED FOR BIDDING

Revision

1

Sheet Title

SYMBOLS, ABBREVIATIONS, & GENERAL NOTES - MECHANICAL

Project No. IN26034


Drawn By: —

Reviewed By: —

Scale: AS INDICATED

PM0.01

COPYRIGHT © 2023 LUMINAUT, INC. - 11/13/2026 8:40:26 AM - Autodesk Docs://Pulaski County Justice Center_Shower Stall Replacement/26069 - Pulaski Justice Center_MEP_v23.rvt

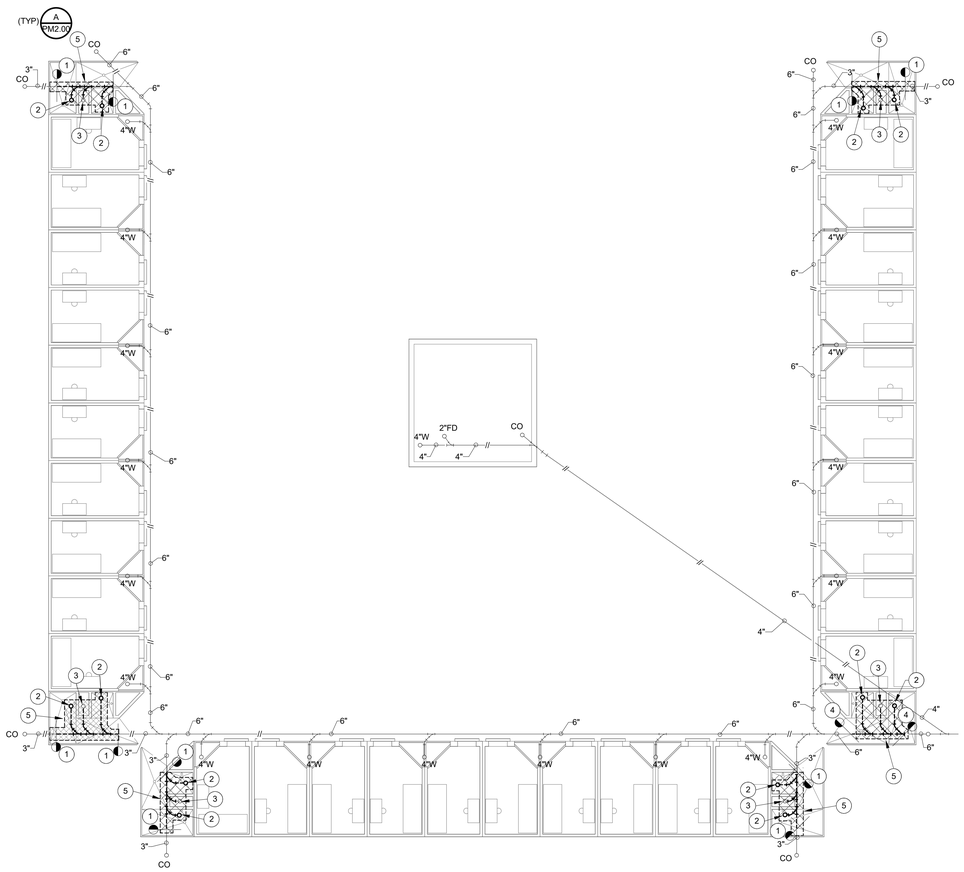

UNDERSLAB PLAN - PLUMBING AND MECHANICAL DEMOLITION

SCALE: 1/8" = 1'-0"

NORTH

DEMOLITION LEGEND:

- WORK TO BE REMOVED
- WORK TO REMAIN

GENERAL NOTES:

1. REFER TO SHEET PM0.01 FOR ADDITIONAL GENERAL NOTES.

(#) PLAN NOTES:

1. REMOVE 3" WASTE PIPING TO THIS POINT. MAKE 3" WASTE PIPING READY FOR NEW CONNECTION.
2. REMOVE 2" WASTE DRAIN FROM FLOOR DRAIN.
3. REMOVE 3" WASTE PIPING TO 3" WASTE STACK. MAKE 3" WASTE STACK READY FOR NEW CONNECTION.
4. REMOVE 6" WASTE PIPING TO THIS POINT. MAKE 6" WASTE PIPING READY FOR NEW CONNECTION.
5. SAW CUT MINIMAL AMOUNT OF EXISTING CONCRETE SLAB FOR REMOVAL OF UNDERSLAB WASTE PIPING. REFER TO ARCHITECTURAL DRAWINGS FOR EXTENT OF SCOPE.

LUMINAUT
1100 Sycamore Street, Suite 200
Cincinnati, Ohio 45202 - Ph: 513.984.1070
702 N. Capitol Avenue
Indianapolis, Indiana 46204
Ph: 317.636.3980
www.luminaut.com

D&A #26069

R.E. Dimond and Associates, Inc.
Consulting Engineers
732 North Capitol Avenue
Indianapolis, IN 46204
Phone: (317) 534-4672
Fax: (317) 638-8725

Project Title

Pulaski County Justice Center - Shower Replacement

110 E. Meridian St.
Winamac, IN 46996

ALEXANDER MICHAEL BELT
REGISTERED
No. 12400523
STATE OF INDIANA
PROFESSIONAL ENGINEER

11/16/2026

Issue Date: November 16, 2026

Issued for: ISSUED FOR BIDDING

Revision

1

Sheet Title

UNDERSLAB PLAN - PLUMBING AND MECHANICAL AND MECHANICAL DEMOLITION

Project No. IN26034

Drawn By: TJG

Reviewed By: TJG

Scale: AS INDICATED

0 2 4 6 8 16 24 32
1 2 3 4

PMD2.00

COPYRIGHT © 2023 LUMINAUT, INC. - 11/12/2026 8:40:28 AM - Autodesk Docs://Pulaski County Justice Center_Shower Stall Replacement/26069 - Pulaski Justice Center - MEP_v24.rvt

DEMOLITION LEGEND:


- WORK TO BE REMOVED
- WORK TO REMAIN

GENERAL NOTES:

1. REFER TO SHEET PM0.01 FOR ADDITIONAL GENERAL NOTES.


(#) PLAN NOTES:

1. REMOVE SHOWER DRAIN.
2. REMOVE 2" PIPING FROM SHOWER DRAIN ABOVE.
3. REMOVE 2" WASTE PIPING BACK TO WASTE STACK. MAKE WASTE STACK READY FOR NEW CONNECTION.
4. REMOVE SHOWER STALL COMPLETE. REMOVE PUSH BUTTON SHOWER VALVE AND ELECTRONIC CONTROLS.
5. REMOVE HOT WATER AND COLD WATER SHOWER SUPPLIES BACK TO RISERS. MAKE HOT WATER AND COLD WATER RISERS READY FOR NEW CONNECTION.
6. SEE PMD2.00 AND ARCHITECTURAL DRAWINGS FOR SAW CUUTING CONCRETE FLOOR SCOPE OF WORK.
7. DISCONNECT 6" EXHAUST DUCT FROM PERFORATED WALL PANEL. REMOVE 6" EXHAUST DUCT RISER.

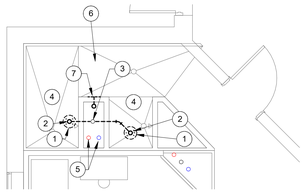


1 POD A - LEVEL 1 - PLUMBING AND MECHANICAL DEMOLITION

SCALE: 1/4" = 1'-0"

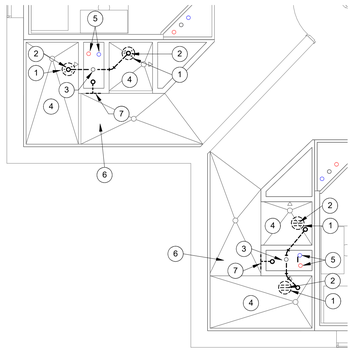


2 POD B AND POD C - LEVEL 1 - PLUMBING AND MECHANICAL DEMOLITION

SCALE: 1/4" = 1'-0"

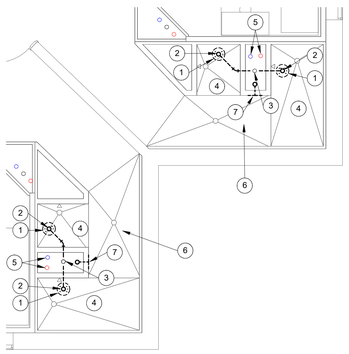


3 POD D AND POD E - LEVEL 1 - PLUMBING AND MECHANICAL DEMOLITION

SCALE: 1/4" = 1'-0"



4 POD G - LEVEL 1 - PLUMBING AND MECHANICAL DEMOLITION

SCALE: 1/4" = 1'-0"

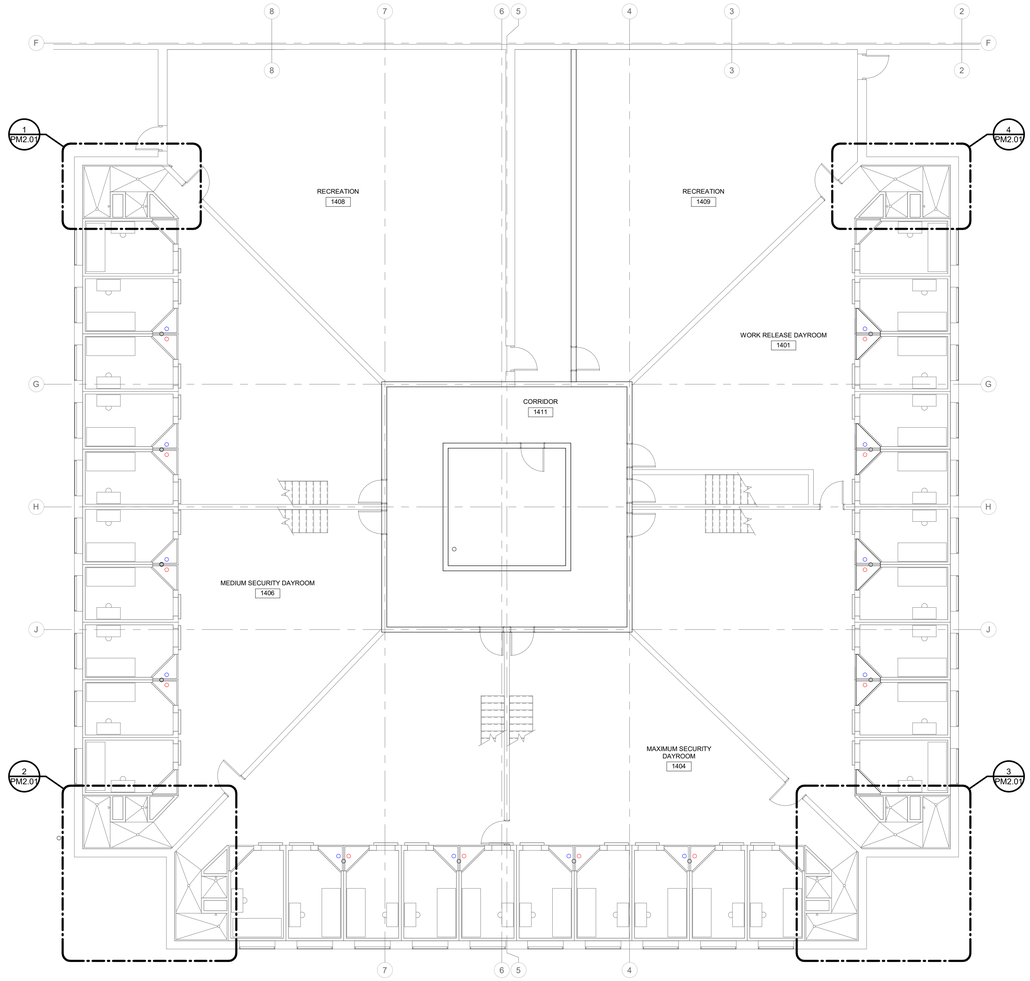

NORTH

OVERALL LEVEL 1 - PLUMBING AND MECHANICAL DEMOLITION

SCALE: 1/8" = 1'-0"

LUMINAUT
1100 Sycamore Street, Suite 200
Cincinnati, Ohio 45202 - Ph: 513.984.1070
702 N. Capitol Avenue
Indianapolis, Indiana 46204
Ph: 317.636.3980
www.luminaut.com

D&A #26069
R.E. Dimond and Associates, Inc.
Consulting Engineers
732 North Capitol Avenue
Indianapolis, IN 46204
Phone: (317) 534-4672
Fax: (317) 638-8725

Project Title

Pulaski County Justice Center - Shower Replacement

110 E. Meridian St.
Winamac, IN 46996

ALEXANDER MICHAEL BELZ · REGISTERED · No. 12400523 · STATE OF INDIANA · PROFESSIONAL ENGINEER

11/16/2026

Issue Date: November 16, 2026

Issued for: ISSUED FOR BIDDING

Revision

1

Sheet Title

LEVEL 1 FLOOR PLANS - PLUMBING AND MECHANICAL DEMOLITION

Project No. IN26034


Drawn By: TJG

Reviewed By: TJG

Scale: AS INDICATED


PMD2.01

COPYRIGHT © 2023 LUMINAUT, INC. - 11/12/2026 8:49:31 AM - Autodesk Docs://Pulaski County Justice Center Shower Stall Replacement/26069 - Pulaski Justice Center - MEP_v24.rvt



1 POD A - LEVEL 2 - PLUMBING AND MECHANICAL DEMOLITION

SCALE: 1/4" = 1'-0"

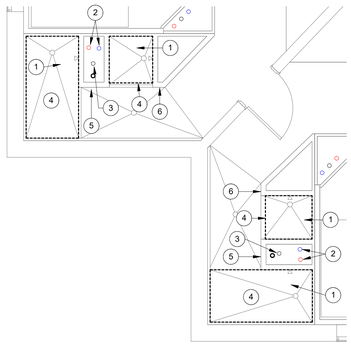


2 POD B AND POD C - LEVEL 2 - PLUMBING AND MECHANICAL DEMOLITION

SCALE: 1/4" = 1'-0"


3 POD D AND POD E - LEVEL 2 - PLUMBING AND MECHANICAL DEMOLITION

SCALE: 1/4" = 1'-0"



4 POD F - LEVEL 2 - PLUMBING AND MECHANICAL DEMOLITION

SCALE: 1/4" = 1'-0"

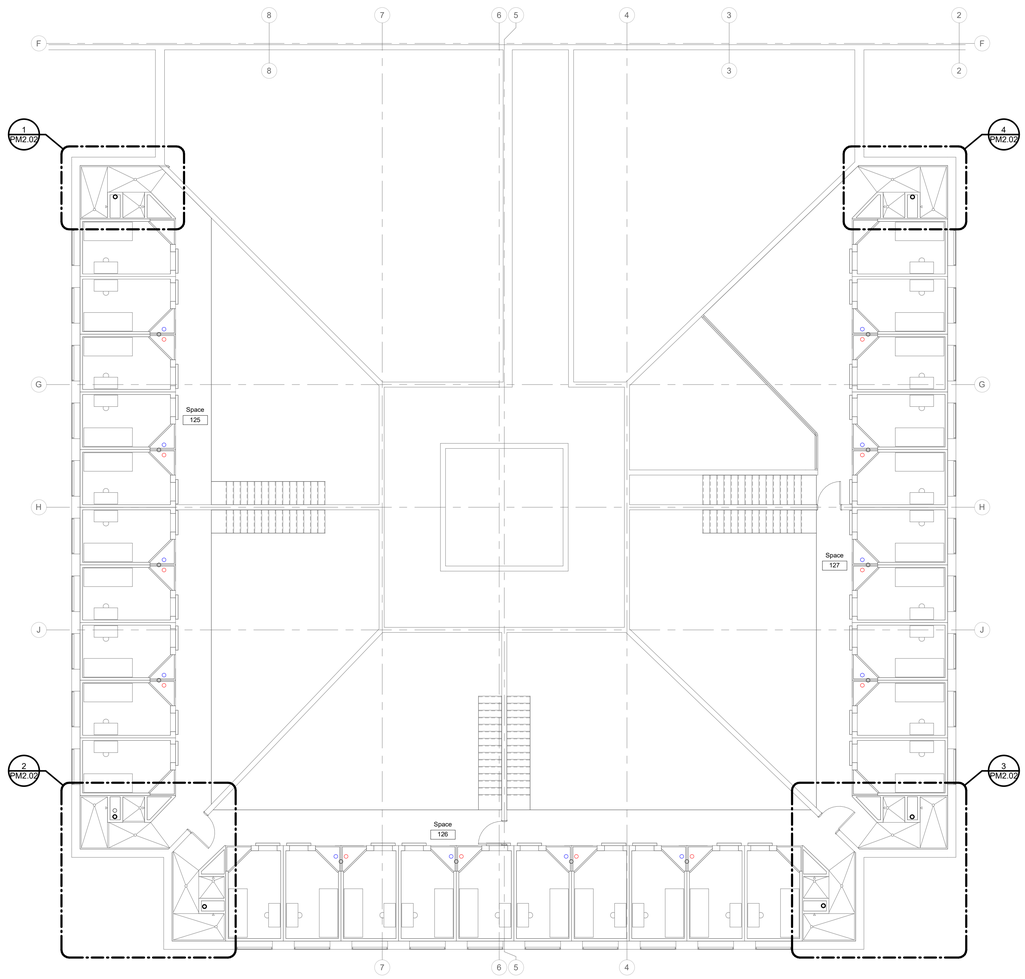

OVERALL LEVEL 2 - PLUMBING AND MECHANICAL DEMOLITION

SCALE: 1/8" = 1'-0"

DEMOLITION LEGEND:

- WORK TO BE REMOVED
- WORK TO REMAIN

GENERAL NOTES:

1. REFER TO SHEET PM0.01 FOR ADDITIONAL GENERAL NOTES.

(#) PLAN NOTES:

1. REMOVE SHOWER DRAIN.
2. REMOVE HOT WATER AND COLD WATER SHOWER SUPPLIES BACK TO RISERS. MAKE HOT WATER AND COLD WATER RISERS READY FOR NEW CONNECTION.
3. 3" WASTE STACK TO REMAIN.
4. REMOVE SHOWER STALL COMPLETE. REMOVE PUSH BUTTON SHOWER VALVE AND ELECTRONIC CONTROLS.
5. DISCONNECT 6" FLEX DUCT FROM PERFORATED WALL PANEL. REMOVE EXHAUST DUCT BACK TO MAIN DUCT AND MAKE READY FOR NEW CONNECTION.
6. REMOVE SPRINKLER HEAD. MAKE ARM OVER PIPING READY FOR NEW CONNECTION.

LUMINAUT
1100 Sycamore Street, Suite 200
Cincinnati, Ohio 45202 - Ph: 513.984.1070
702 N. Capitol Avenue
Indianapolis, Indiana 46204
Ph: 317.636.3980
www.luminaut.com

D&A #26069
R.E. Dimond and Associates, Inc.
Consulting Engineers
732 North Capitol Avenue
Indianapolis, IN 46204
Phone: (317) 634-4672
Fax: (317) 638-8725

Project Title

Pulaski County Justice Center - Shower Replacement

110 E. Meridian St.
Winamac, IN 46996

REGISTERED ALEXANDER MICHAEL BETZ No. 12400523 STATE OF INDIANA PROFESSIONAL ENGINEER
11/16/2026

Issue Date: November 16, 2026

Issued for: ISSUED FOR BIDDING

Revision

1

Sheet Title

LEVEL 2 FLOOR PLANS - PLUMBING AND MECHANICAL DEMOLITION

Project No. IN26034


Drawn By: TJG

Reviewed By: TJG

Scale: AS INDICATED

PMD2.02

COPYRIGHT © 2022 LUMINAUT, INC. - 11/13/2026 8:40:33 AM - Autodesk Docs://Pulaski County Justice Center - Shower Stall Replacement/25099 - Pulaski Justice Center - MEP - v24.rvt

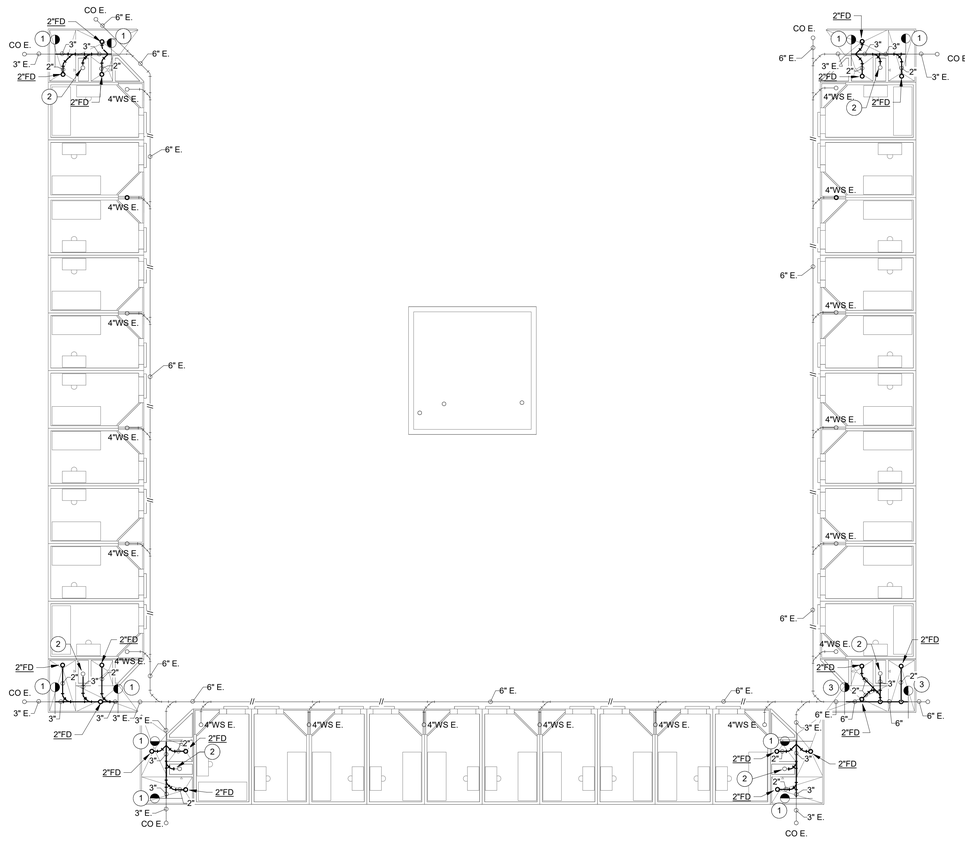

RENOVATION LEGEND:

- WORK TO BE INSTALLED
- WORK TO REMAIN

GENERAL NOTES:

1. REFER TO SHEET PM0.01 FOR ADDITIONAL GENERAL NOTES.


PLAN NOTES:

1. CONNECT 3" WASTE PIPING TO EXISTING 3" WASTE PIPING.
2. CONNECT 3" WASTE PIPING TO EXISTING 3" WASTE STACK.
3. CONNECT 6" WASTE PIPING TO EXISTING 6" WASTE PIPING.

UNDERSLAB PLAN - PLUMBING AND MECHANICAL

NORTH

SCALE: 1/8" = 1'-0"



A FLOOR SLAB CUT/PATCH

SCALE: NONE

0 2 4 6 8 16 24 32

1 2 3 4

LUMINAUT
1100 Sycamore Street, Suite 200
Cincinnati, Ohio 45202 - Ph: 513.984.1070

702 N. Capitol Avenue
Indianapolis, Indiana 46204
Ph: 317.636.3980

www.luminaut.com

D&A #26069

R.E. Dimond and Associates, Inc.
Consulting Engineers
732 North Capitol Avenue
Indianapolis, IN 46204
Phone: (317) 534-4672
Fax: (317) 638-8725

Project Title

Pulaski County Justice Center - Shower Replacement

110 E. Meridian St.
Winamac, IN 46996

ALEXANDER MICHAEL BELL REGISTERED No. 12400523 STATE OF INDIANA PROFESSIONAL ENGINEER

11/16/2026

Issue Date: November 16, 2026

Issued for: ISSUED FOR BIDDING

Revision

1

Sheet Title

UNDERSLAB PLAN - PLUMBING AND MECHANICAL

Project No. IN26034


Drawn By: TJG

Reviewed By: TJG

Scale: AS INDICATED


PM2.00

COPYRIGHT © 2022 LUMINAUT, INC. - 11/13/2026 8:40:34 AM - Autodesk Docs://Pulaski County Justice Center - Shower Stall Replacement/26069 - Pulaski Justice Center - MEP_v24.rvt

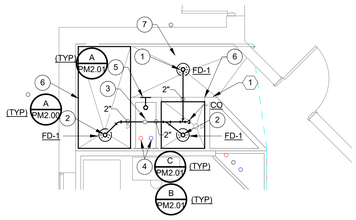


1 POD A - LEVEL 1 - PLUMBING AND MECHANICAL

SCALE: 1/4" = 1'-0"

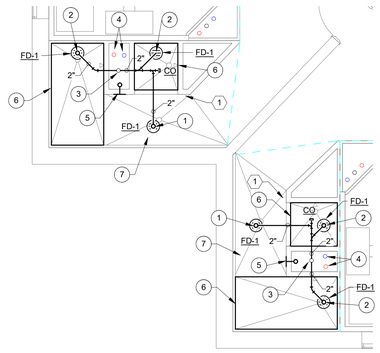


2 POD B AND POD C - LEVEL 1 - PLUMBING AND MECHANICAL

SCALE: 1/4" = 1'-0"

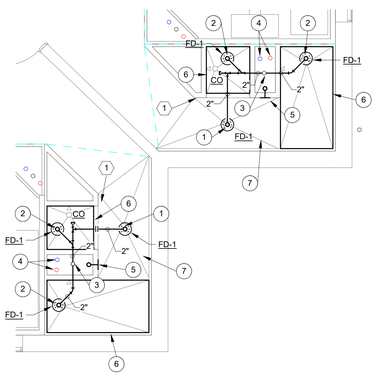


3 POD D AND POD E - LEVEL 1 - PLUMBING AND MECHANICAL

SCALE: 1/4" = 1'-0"



4 POD G - LEVEL 1 - PLUMBING AND MECHANICAL


SCALE: 1/4" = 1'-0"

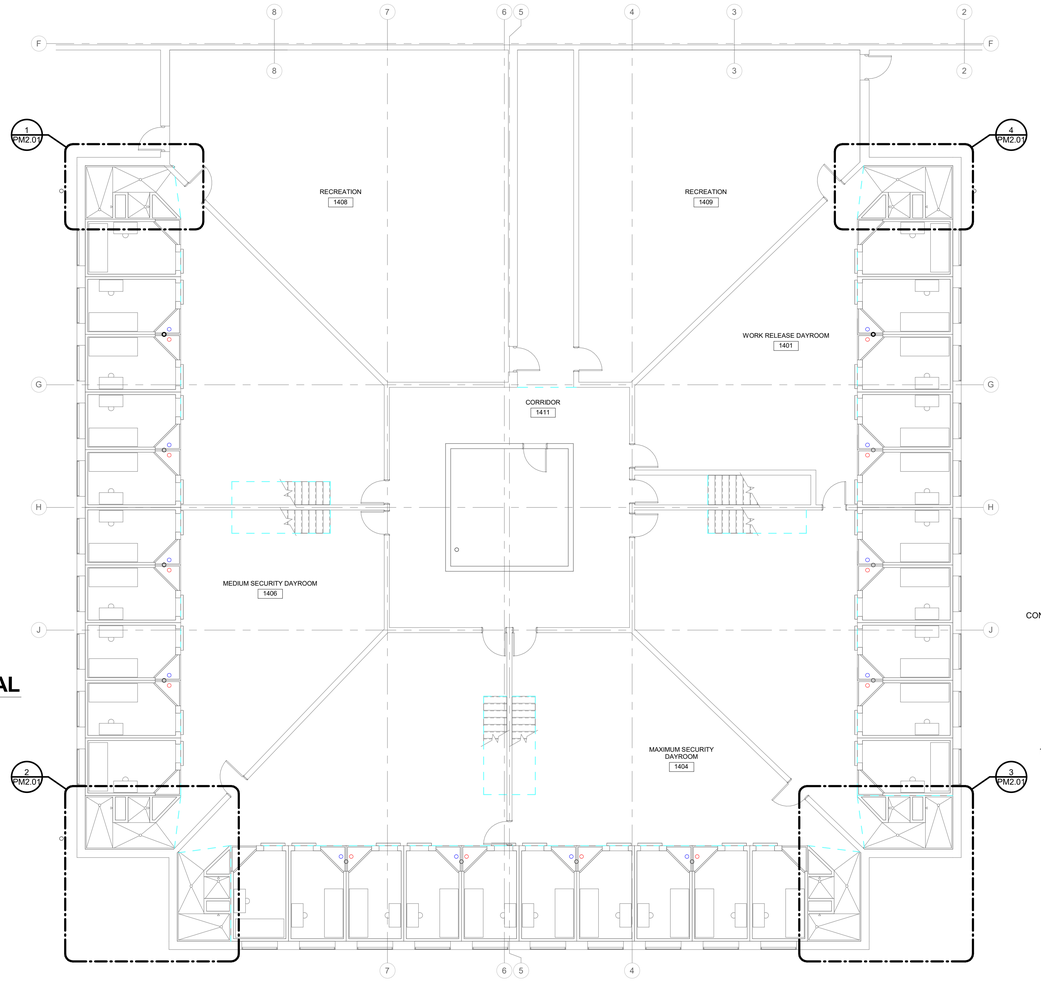

OVERALL LEVEL 1 - PLUMBING AND MECHANICAL

SCALE: 1/8" = 1'-0"

NORTH

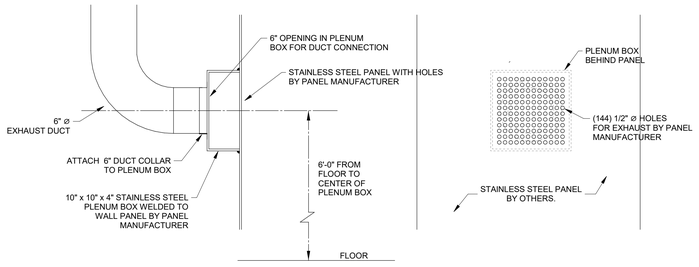

SECTION **ELEVATION**

A EXHAUST DUCT CONNECTION

SCALE: NONE

RENOVATION LEGEND:

- WORK TO BE INSTALLED
- WORK TO REMAIN

GENERAL NOTES:


1. REFER TO SHEET PM0.01 FOR ADDITIONAL GENERAL NOTES.
2. COORDINATE PLUMBING CONNECTIONS FOR SHOWERS AND DRAINS WITH SHOWER UNIT MANUFACTURER.
3. COORDINATE FIRE PROTECTION SHUT DOWN FOR SPRINKLER HEAD REPLACEMENT WITH OWNER.
4. CONTRACTOR SHALL INSPECT EXISTING SHOWER WASTE AND VENT STACKS AND REPLACE ANY SECTIONS FOUND TO BE DAMAGED, DETERIORATED, OR NONCOMPLIANT WITH CURRENT CODE. ALL WORK TO BE PERFORMED AS AGREED UPON UNIT COST.

PLAN NOTES:

1. 2" FROM PREFABRICATED FLOOR DRAIN ABOVE.
2. CONNECT 2" TO PREFABRICATED SHOWER DRAIN ABOVE.
3. CONNECT 2" WASTE PIPING TO EXISTING 3" WASTE/VENT STACK.
4. CONNECT 3/4" HOT WATER AND COLD WATER TO EXISTING 3/4" HOT WATER AND COLD WATER RISERS. ROUTE HOT AND COLD WATER PIPING TO ELECTRONIC PUSH BUTTON SHOWER VALVE AND CONNECT.
5. CONNECT 6" DUCTWORK TO DUCT CONNECTION ON WALL PANEL. PERFORATIONS IN WALL PANEL EQUAL TO 24 SQUARE INCHES OF FREE OPEN AREA BY PANEL MANUFACTURER. 6" EXHAUST DUCT UP.
6. SHOWER STALL ASSEMBLY BY OTHERS. SEE ARCHITECTURAL DRAWINGS.
7. PATCH CONCRETE FLOOR. COORDINATE WITH ARCHITECT DRAWINGS AND DETAIL A ON DRAWING PM2.00


PLAN NOTES - FIRE PROTECTION

1. REMOVE AND REPLACE SECURITY STYLE SIDEWALL SPRINKLER HEAD. PROVIDE SECURITY/INSTITUTIONAL SPRINKLER SIMILAR TO VIKING

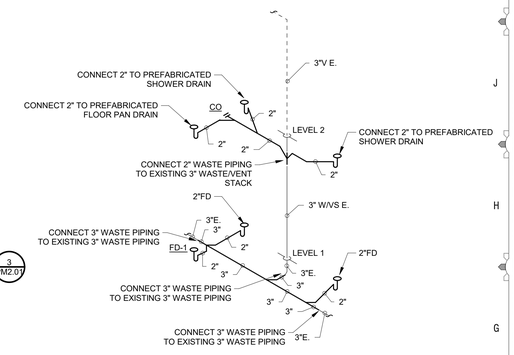

B TYPICAL WASTE AND VENT DIAGRAM

SCALE: NONE

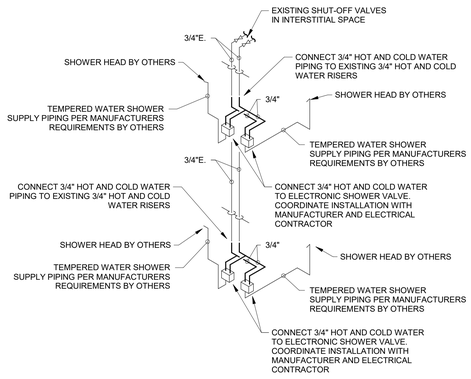

C TYPICAL HOT AND COLD WATER DIAGRAM

SCALE: NONE

LUMINAUT
1100 Sycamore Street, Suite 200
Cincinnati, Ohio 45202 - Ph: 513.984.1070
702 N. Capitol Avenue
Indianapolis, Indiana 46204
Ph: 317.636.3980
www.luminaut.com

D&A #26069
R.E. Dimond and Associates, Inc.
Consulting Engineers
732 North Capitol Avenue
Indianapolis, IN 46204
Phone: (317) 634-4672
Fax: (317) 638-8725

Project Title

Pulaski County Justice Center - Shower Replacement

110 E. Meridian St.
Winamac, IN 46996

ALEXANDER MICHAEL BELL — REGISTERED — No. 12400523 — STATE OF INDIANA — PROFESSIONAL ENGINEER
11/16/2026

Issue Date: November 16, 2026

Issued for: ISSUED FOR BIDDING

Revision

1

Sheet Title

LEVEL 1 FLOOR PLANS - PLUMBING AND MECHANICAL

Project No. IN26034

Drawn By: TJG


Reviewed By: TJG

Scale: AS INDICATED

0 2 4 6 8 16 24 32
1 2 3 4


PM2.01

COPYRIGHT © 2026 LUMINAUT, INC. 11/12/2026 8:45:27 AM - Autodesk Docs://Pulaski County Justice Center - Shower Stall Replacement/25069 - Pulaski Justice Center - MEP_r24.rvt




1 POD A - LEVEL 2 - PLUMBING

SCALE: 1/4" = 1'-0"

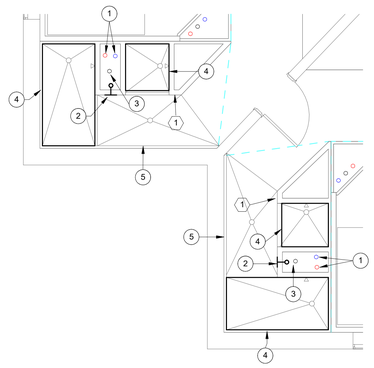


2 POD B AND POD C - LEVEL 2 - PLUMBING

SCALE: 1/4" = 1'-0"

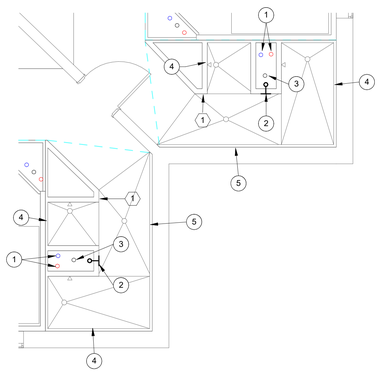


3 POD D AND POD E - LEVEL 2 - PLUMBING

SCALE: 1/4" = 1'-0"



4 POD F - LEVEL 2 - PLUMBING

SCALE: 1/4" = 1'-0"

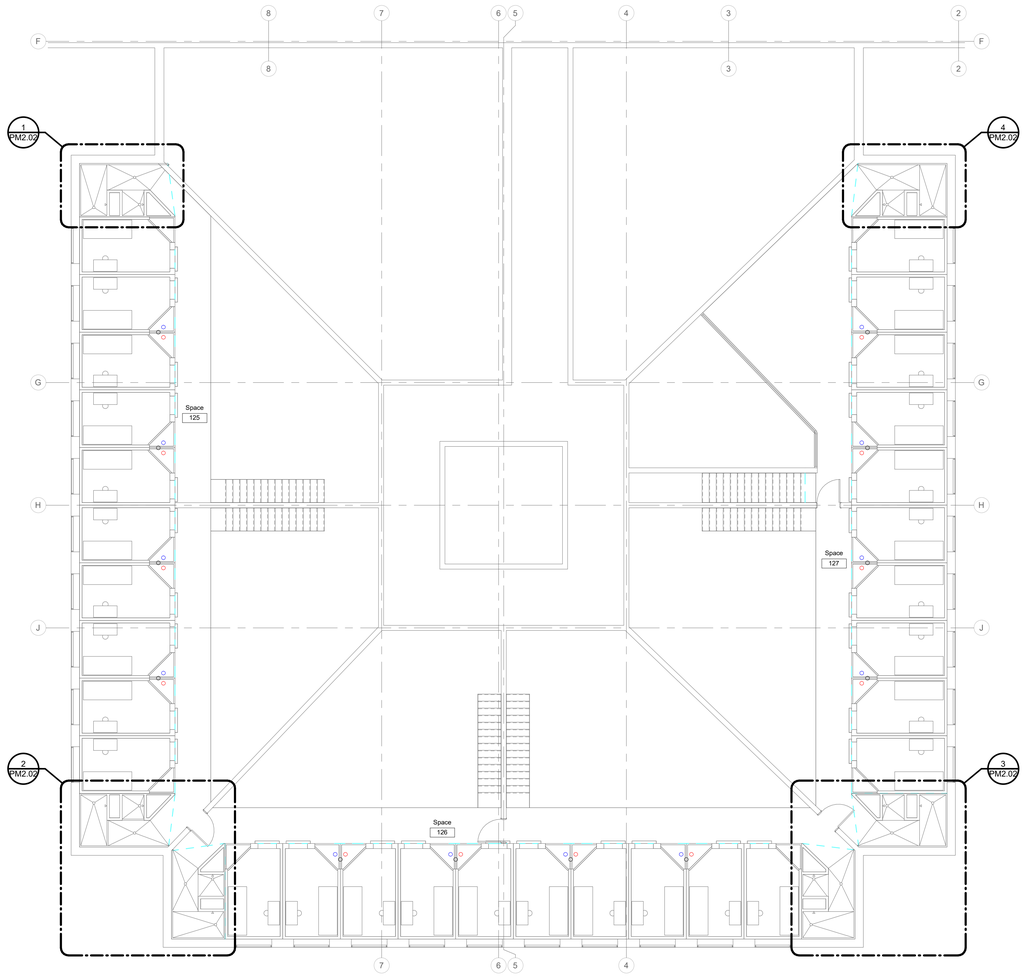

OVERALL LEVEL 2 - PLUMBING AND MECHANICAL

SCALE: 1/8" = 1'-0"

NORTH

RENOVATION LEGEND:

WORK TO BE INSTALLED

WORK TO REMAIN

GENERAL NOTES:

1. REFER TO SHEET PM0.01 FOR ADDITIONAL GENERAL NOTES.
2. COORDINATE PLUMBING CONNECTIONS FOR SHOWERS AND DRAINS WITH SHOWER UNIT MANUFACTURER.
3. COORDINATE FIRE PROTECTION SHUT DOWN FOR SPRINKLER HEAD REPLACEMENT WITH OWNER.

PLAN NOTES:

1. CONNECT 3/4" HOT WATER AND COLD WATER TO EXISTING 3/4" HOT WATER AND COLD WATER RISERS. ROUTE HOT AND COLD WATER PIPING TO ELECTRONIC PUSH BUTTON SHOWER VALVE AND CONNECT. ELECTRONIC PUSH BUTTON SHOWER VALVE BY OTHERS.
2. CONNECT 6" FLEX DUCTWORK TO DUCT CONNECTION ON WALL PANEL. PROVIDE PERFORATIONS IN WALL PANEL EQUAL TO 24 SQUARE INCHES OF FREE OPEN AREA. CONNECT 6" EXHAUST DUCT TO 6" EXHAUST DUCT RISER. CONNECT 6" EXHAUST DUCT TO EXISTING EXHAUST DUCT ABOVE CEILING IN THE INTERSTITIAL ATTIC SPACE.
3. EXISTING 3" WASTE/VENT STACK.
4. SHOWER STALL ASSEMBLY BY OTHERS. SEE ARCHITECTURAL DRAWINGS.
5. FLOOR PAN WITH DRAIN BY OTHERS.

PLAN NOTES - FIRE PROTECTION

1. REMOVE AND REPLACE SECURITY STYLE SIDEWALL SPRINKLER HEAD.

0 2 4 6 8 16 24 32

1 2 3 4

LUMINAUT
1100 Sycamore Street, Suite 200
Cincinnati, Ohio 45202 - Ph: 513.984.1070
702 N. Capitol Avenue
Indianapolis, Indiana 46204
Ph: 317.636.3980
www.luminaut.com

D&A #26069
R.E. Dimond and Associates, Inc.
Consulting Engineers
732 North Capitol Avenue
Indianapolis, IN 46204
Phone: (317) 534-4672
Fax: (317) 638-8725

Project Title

Pulaski County Justice Center - Shower Replacement

110 E. Meridian St.
Winamac, IN 46996

ALEXANDER MICHAEL BELT
REGISTERED
No. 12400523
STATE OF INDIANA
PROFESSIONAL ENGINEER

11/16/2026

Issue Date: November 16, 2026

Issued for: ISSUED FOR BIDDING

Revision

1

Sheet Title

LEVEL 2 FLOOR PLANS - PLUMBING

Project No. IN26034

Drawn By: TJS

Reviewed By: TJS

Scale: AS INDICATED

PM2.02


COPYRIGHT © 2023 LUMINAUT, INC. - 11/12/2026 8:40:40 AM - Autodesk Docs://Pulaski County Justice Center -Shower Stall Replacement/26069 - Pulaski Justice Center - MEP_r24.rvt

ABBREVIATIONS

A	AMPERE
AC	ALTERNATING CURRENT; ARMORED CABLE
ADJ	ADJUSTABLE
AF	AMPERE FUSE; AMPERE FRAME
AFF	ABOVE FINISHED FLOOR
AFG	ABOVE FINISHED GRADE
AIC	AMPERE INTERRUPTING CAPACITY
AL	ALUMINUM
ALCR	AUTOMATIC LOAD CONTROL RELAY
ANSI	AMERICAN NATIONAL STANDARDS INSTITUTE
ASYM	ASYMMETRICAL
AT	AMPERE TRIP
ATS	AUTOMATIC TRANSFER SWITCH
AUX	AUXILIARY
AVG	AVERAGE
AWG	AMERICAN WIRE GUAGE
BATT	BATTERY
BPS	BOLTED PRESSURE SWITCH
C	CONDUIT; CENTRIGRADE
C/C	CENTER TO CENTER
CB	CIRCUIT BREAKER
CCTV	CLOSED CIRCUIT TELEVISION
CD	CANDELA
CF	CUBIC FEET
CFL	COMPACT FLUORESCENT
CIRC	CIRCUIT
CLG	CEILING
CMU	CONCRETE MASONRY UNIT
COL	COLUMN
COMB	COMBINATION
CONC	CONCRETE
COND	CONDUCTOR
CONT	CONTINUOUS; CONTINUED
CP	CONTROL PANEL
CPT	CONTROL POWER TRANSFORMER
CT	CURRENT TRANSFORMER
CU	COPPER; CUBIC
CU FT	CUBIC FOOT
CY	CUBIC YARD
CYL	CYLINDER
D	DEEP; DEPTH
DB	DECIBEL; DIRECT BURIED
DC	DIRECT CURRENT
DDC	DIRECT DIGITAL CONTROL
DF	DUAL FACE
DIA	DIAMETER
DIAG	DIAGONAL
DISC	DISCONNECT
DISTR	DISTRIBUTION
DN	DOWN
DPDT	DOUBLE POLE, DOUBLE THROW
DPST	DOUBLE POLE, SINGLE THROW
DWG	DRAWING
DX	DIRECT EXPANSION
E	EAST; EXISTING
EA	EACH
EBBR	ELECTRIC BASEBOARD RADIATION
EB	ELECTRONIC BALLAST
EC	ELECTRICAL CONTRACTOR
EGC	EQUIPMENT GROUNDING CONDUCTOR
ELEC	ELECTRICAL
ELEV	ELEVATOR; ELEVATION
EM	EMERGENCY
EMS	ENERGY MANAGEMENT SYSTEM
EMT	ELECTRICAL METALLIC TUBING
ENCL	ENCLOSURE
ENG	ENGINE
EQUIP	EQUIPMENT
EST	ESTIMATED
EWC	ELECTRIC WATER COOLER
EWH	ELECTRIC WATER HEATER
EXP	EXPOSED
EXT	EXTERIOR
F	FUSED; FAHRENHEIT
FA	FIRE ALARM
FAA	FIRE ALARM ANNUNCIATOR
FACP	FIRE ALARM CONTROL PANEL
FC	FOOT-CANDLE
FD	FUSED DISCONNECT
FDR	FEEDER
FIN	FINISHED
FIXT	FIXTURE
FLA	FULL LOAD AMPS
FLR	FLOOR
FLUOR	FLUORESCENT
FM	FREQUENCY MODULATION; FACTORY MUTUAL
FT	FOOT; FEET
FURN	FURNISHED
FVNR	FULL VOLTAGE NON-REVERSING
G	GROUND
GA	GUAGE
GALV	GALVANIZED
GC	GENERAL CONTRACTOR
GEN	GENERATOR
GFCI; GFI	GROUND FAULT CIRCUIT INTERRUPTER
GFP	GROUND FAULT PROTECTION
GND	GROUND
GRS, GRC	GALVANIZED RIGID STEEL CONDUIT
H	HIGH
HD	HEAVY DUTY; HIGH DEFINITION
HG	MERCURY
HOA	HAND-OFF-AUTOMATIC
HORIZ	HORIZONTAL
HP	HORSEPOWER
HPS	HIGH PRESSURE SODIUM
HR	HOUR
HRS/DAY	HOURS PER DAY
HT	HEIGHT
HV	HIGH VOLTAGE
HZ	HERTZ
ID	INSIDE DIAMETER
IDF	INTERMEDIATE DISTRIBUTION FRAME
IEEE	INSTITUTE OF ELECTRICAL AND ELECTRONICS ENGINEERS
IG	ISOLATED GROUND
IMC	INTERMEDIATE METAL CONDUIT
IMP	IMPEDANCE
IN	INCH
INCAN	INCANDESCENT
INSUL	INSULATION; INSULATED
INT	INTERIOR; INTERNAL
INV EL	INVERTED ELEVATION
J	JOULE; JUNCTION
JB	JUNCTION BOX
K	THOUSAND
KCMIL	THOUSAND CIRCULAR MILS
KHZ	KILOHERTZ
KK	KIRK KEY
KP	KEYPAD
KV	KILOVOLT
KVA	KILOVOLT AMPERE
KVAR	KILOVOLT AMPERE REACTIVE
KW	KILOWATT
KWH	KILOWATT-HOUR
L	LENGTH; LONG; LUMEN
LB	POUND; ELL CONDUIT BODY
LED	LIGHT EMITTING DIODE
LF	LINEAR FOOT
LLD	LAMP LUMEN DEPRECIATION
LO	LOCK OUT
LRA	LOCKED ROTOR AMPS
LT	LIGHT; LIQUID-TIGHT
LTG	LIGHTING
LV	POWER LIMITED LOW VOLTAGE
M	METER
MA	MILLIAMPERE
MAG STR	MAGNETIC STARTER
MAN	MANUAL
MAT	MATERIAL
MATV	MASTER ANTENNA TELEVISION
MAX	MAXIMUM
MC	METAL CLAD CABLE; MOTOR CONTROLLER
MCA	MINIMUM CIRCUIT AMPS
MCB	MAIN CIRCUIT BREAKER
MCC	MOTOR CONTROL CENTER
MCCB	MOLDED CASE CIRCUIT BREAKER
MCM	THOUSAND CIRCULAR MILS
MCP	MOTOR CIRCUIT PROTECTOR
MCS	MOTOR CIRCUIT SWITCH
MDF	MAIN DISTRIBUTION FRAME
MDP	MAIN DISTRIBUTION PANELBOARD
MED	MEDIUM
MFG	MANUFACTURING
MFR	MANUFACTURER
MH	MANHOLE; METAL HALIDE; MAN-HOUR
MHZ	MEGAHERTZ
MI	MINERAL INSULATED
MIC	MICROPHONE
MIN	MINIMUM; MINUTE
MISC	MISCELLANEOUS
MLO	MAIN LUGS ONLY
MOCP	MAXIMUM OVERCURRENT PROTECTION
MOG	MOGUL
MTD	MOUNTED
MTS	MANUAL TRANSFER SWITCH
MV	MEGAVOLT; MEDIUM VOLTAGE
MVA	MEGAVOLT AMPERES
MVAR	MEGAVOLT AMPERES REACTIVE
MW	MEGAWATT
N	NEUTRAL
N/A	NOT APPLICABLE
NC	NORMALLY CLOSED
NEC	NATIONAL ELECTRICAL CODE
NEMA	NATIONAL ELECTRICAL MANUFACTURERS ASSOCATION
NF	NON-FUSED
NFS	NON-FUSED DISCONNECT
NIC	NOT IN CONTRACT
NL	NIGHT LIGHT
NM	NON-METALLIC SHEATHED CABLE
NO	NUMBER; NORMALLY OPEN
NTS	NOT TO SCALE
O&P	OVERHEAD AND PROFIT
OC	ON CENTER; OVERCURRENT
OD	OUTSIDE DIAMETER
OH	OVERHEAD
OL	OVERLOAD
OS&Y	OUTSIDE SCREW AND YOKE
OZ	OUNCE
P	POLE; PULL
PA	PUBLIC ADDRESS
PB	PUSH BUTTON; PULL BOX
PC	PHOTOCELL
PED	PEDESTAL
PF	POWER FACTOR
PH	PHASE
PIV	POST INDICATOR VALVE
PL	PILOT LIGHT
PNL	PANEL
PR	PAIR
PRI	PRIMARY
PSF	POUNDS PER SQUARE FOOT
PSI	POUNDS PER SQUARE INCH
PSIG	POUNDS PER SQUARE INCH GUAGE
PT	POTENTIAL TRANSFORMER
PU	PER UNIT
PVC	POLYVINYL CHLORIDE
PWR	POWER
R	RESISTANCE; RELOCATED
RECEPT	RECEPTACLE
REF	REFERENCE
REFR	REFRIGERATOR
REQD	REQUIRED
RGS	RIGID GALVANIZED STEEL
RLA	RUNNING LOAD AMPS
RM	ROOM
RMC	RIGID METALLIC CONDUIT
RMS	ROOT MEAN SQUARE
RNC	RIGID NON-METALLIC CONDUIT
RT	RAINTIGHT
SCCR	SHORT-CIRCUIT CURRENT-RATING
SCHED	SCHEDULE
SCR	SHORT CIRCUIT RATING
SE	SERVICE ENTRACE; SERVICE EQUIPMENT
SEC	SECONDARY
SN	SOLID NEUTRAL
SP	SINGLE POLE
SPD	SURGE PROTECTIVE DEVICE
SPDT	SINGLE POLE, DOUBLE THROW
SPKR	SPEAKER
SPST	SINGLE POLE, SINGLE THROW
SQ	SQUARE
SQ FT	SQUARE FEET
SQ IN	SQUARE INCH
SS	STAINLESS STEEL; SAFETY SWITCH
S/S	START STOP
ST	SHUNT TRIP;
STD	STANDARD
SURF	SURFACE
SW	SWITCH
SWD	SWITCHING DUTY
SWBD	SWITCHBOARD
SQ YD	SQUARE YARD
SYM	SYMMETRICAL
T	TEMPERATURE; TRANFORMER
TB	TERMINAL BLOCK
TC	TIME CLOCK
TCC	TEMPERATURE CONTROLS CONTRACTOR
TCP	TEMPERATURE CONTROL PANEL
TD	TIME DELAY
TELE	TELEPHONE
TGB	TELECOMMUNICATIONS GROUNDING BUSBAR
THD	TOTAL HARMONIC DISTORTION; THREAD
TMGB	TELECOMMUNICATIONS MAIN GROUNDING BUSBAR
TO	TELECOMMUNICATIONS OUTLET
TR	TAMPER RESISTANT
TTB	TELEPHONE TERMAINAL BOARD
TV	TELEVISION
TVSS	TRANSIENT VOLTAGE SURGE SUPPRESSOR
TYP	TYPICAL
UC	UNDER (CABINET OR COUNTER)
UF	UNDERGROUND FEEDER
UG	UNDERGROUND
UHF	ULTRA HIGH FREQUENCY
UL	UNDERWRITERS LABORATORY
UNFIN	UNFINISHED
UNO	UNLESS NOTED OTHERWISE
UTIL	UTILITY
UTP	UNSHIELDED TWISTED PAIR
V	VOLT
VA	VOLT AMPERES
VAR	VOLT AMPERES REACTIVE
VERT	VERTICAL
VFD	VARIABLE FREQUENCY DRIVE
VHF	VERY HIGH FREQUENCY
VOL	VOLUME
W	WIRE; WATT; WIDE
W/	WITH
WAP	WIRELESS ACCESS POINT
WG	WIRE GUARD
WM	"WIREMOLD" (SURFACE RACEWAY)
WP	WEATHERPROOF
WT	WEIGHT; WATERTIGHT
XFMR	TRANSFORMER
XFER	TRANSFER
Y	WYE
'	DEGREE
Δ	DELTA
Ø	PHASE; DIAMETER
#	POUND; NUMBER
%	PERCENT
@	AT
~	APPROXIMATELY
'	FEET
"	INCHES

NOT ALL SYMBOLS ON THIS SHEET ARE USED IN THESE DOCUMENTS.

TYPICAL WIRING DESIGNATIONS




ROOM CIRCUIT DESIGNATIONS



* INDIVIDUAL CIRCUITS NUMBERS ARE LOCATED AT EACH DEVICE

ROOM CIRCUIT DESIGNATION SHOWN ABOVE APPLY TO EVERY DEVICE IN THE ROOM UNLESS NOTED OTHERWISE

ROOM CIRCUIT DESIGNATIONS WITH RELAY NUMBER




RACEWAYS

- CONDUIT, IN WALL OR CEILING
- CONDUIT, BELOW FLOOR
- CONDUIT, EXPOSED
- W — SURFACE RACEWAY ("WIREMOLD")
- CONDUIT, TURNING UP
- CONDUIT, TURNING DOWN
- 3 CONDUIT, CAPPED
- UNDERFLOOR DUCT & JUNCTION BOX, SINGLE SYSTEM
- UNDERFLOOR DUCT & JUNCTION BOX, DUAL SYSTEM
- UNDERFLOOR DUCT & JUNCTION BOX, TRIPLE SYSTEM
- J JUNCTION BOX
- P PULL BOX

MISCELLANEOUS

- CLOCK (WALL)
- CLOCK (CEILING)
- BELL
- BUZZER
- THERMOSTAT
- ELECTRICAL GROUND

TYPICAL DEVICE DESIGNATIONS

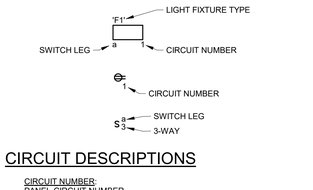

CIRCUIT DESCRIPTIONS

CIRCUIT NUMBER:
PANEL-CIRCUIT NUMBER
(I.E. A1-1)

MULTIPLE INDIVIDUAL CIRCUIT NUMBERS:
PANEL-CIRCUIT NUMBER,CIRCUIT NUMBER,CIRCUIT NUMBER
(I.E. A1-1, A1-3)

2-POLE CIRCUIT NUMBER:
PANEL-CIRCUIT NUMBER/CIRCUIT NUMBER
(I.E. A1-1,3)

3-POLE CIRCUIT NUMBER:
PANEL-CIRCUIT NUMBER/CIRCUIT NUMBER/CIRCUIT NUMBER
(I.E. A1-1,3,5)

PANELS

- PANEL, FLUSH
- PANEL, SURFACE
- CONTROL PANEL (AS NOTED), FLUSH
- CONTROL PANEL (AS NOTED), SURFACE

POWER EQUIPMENT

- 1-PHASE MOTOR
- 3-PHASE MOTOR
- SF FUSIBLE BOX COVER SWITCH
- ENCLOSED SWITCH, NON-FUSIBLE
- F ENCLOSED SWITCH, FUSIBLE
- CB ENCLOSED CIRCUIT BREAKER
- MANUAL MOTOR STARTER
- P MANUAL MOTOR STARTER WITH PILOT LIGHT
- MAGNETIC MOTOR STARTER
- COMBINATION DISCONNECT & MAGNETIC MOTOR STARTER
- T SMALL TRANSFORMER
- VFD VARIABLE FREQUENCY DRIVE
- PUSHBUTTON
- UP/DOWN PUSHBUTTON
- UP/DOWN/STOP PUSHBUTTON

RECEPTACLES AND OUTLETS

- DUPLEX RECEPTACLE
- HORIZONTAL DUPLEX RECEPTACLE
- DOUBLE DUPLEX (QUAD) RECEPTACLE
- DUPLEX RECEPTACLE ABOVE COUNTERTOP OR TOGGLE SWITCH HEIGHT WHERE NO COUNTER IS PRESENT
- DOUBLE DUPLEX (QUAD) RECEPTACLE ABOVE COUNTERTOP OR TOGGLE SWITCH HEIGHT WHERE NO COUNTER IS PRESENT
- GROUND FAULT CIRCUIT INTERRUPTER (GFCI) DUPLEX RECEPTACLE
- HORIZONTAL GFCI DUPLEX RECEPTACLE
- DOUBLE DUPLEX (QUAD) GFCI RECEPTACLE
- GFCI DUPLEX RECEPTACLE ABOVE COUNTERTOP OR TOGGLE SWITCH HEIGHT WHERE NO COUNTER IS PRESENT
- DOUBLE DUPLEX (QUAD) GFCI RECEPTACLE ABOVE COUNTERTOP OR TOGGLE SWITCH HEIGHT WHERE NO COUNTER IS PRESENT
- WP GFCI/ WEATHERPROOF DUPLEX RECEPTACLE
- SINGLE RECEPTACLE
- FLUSH FLOOR OUTLET, ONE DUPLEX RECEPTACLE UNLESS NOTED OTHERWISE
- PT FIRE-RATED POKE-THRU, DUAL-SERVICE WITH ONE QUADRAPLEX RECEPTACLE & FOUR DATA JACKS UNLESS NOTED OTHERWISE
- PED PEDESTAL-TYPE FLOOR OUTLET, ONE DUPLEX RECEPTACLE UNLESS NOTED OTHERWISE
- CEILING DROP CORD. 3#12 TYPE SO CORD WITH 2 DUPLEX RECEPTACLES AND KELLUMS GRIPS UNLESS NOTED OTHERWISE
- CR CORD REEL. 12/3 TYPE SJTW CORD WITH ADJUSTABLE STOP AND 2 DUPLEX RECEPTACLES UNLESS NOTED OTHERWISE
- SPECIAL OUTLET OR EQUIPMENT CONNECTION (AS NOTED)
- RECESSED FLOOR BOX, DUAL-SERVICE WITH 4-GANGS AND TWO DUPLEX RECEPTACLES UNLESS NOTED OTHERWISE
- MULTIOUTLET ASSEMBLY, LENGTH INDICATED, 16" AFF UNLESS NOTED OTHERWISE
  - INDICATES VERTICAL RUN
- LAB TOP PEDESTAL OUTLET, GFCI-TYPE DUPLEX RECEPTACLE
- LAB TOP PEDESTAL OUTLET, GFCI-TYPE QUADRIPLEX RECEPTACLE
- LAB TOP PEDESTAL OUTLET,TWO GFCI-TYPE DUPLEX RECEPTACLES
- LAB TOP PEDESTAL OUTLET, TWO GFCI-TYPE QUADRIPLEX RECEPTACLES

LIGHT FIXTURES

- LIGHT, CEILING
- LIGHT, CEILING
- LIGHT, WALL
- EXIT SIGN, CEILING
- EXIT SIGN, WALL
- EXIT SIGN WITH DIRECTIONAL ARROW, CEILING
- EXIT SIGN WITH DIRECTIONAL ARROW, WALL
- EMERGENCY LIGHTING UNIT
- TRACK LIGHT FIXTURE
- EMERGENCY LIGHT FIXTURE
- LIGHT FIXTURE DIRECTIONAL AIMING INDICATOR
- NL NIGHT LIGHT

SWITCHES

- S SWITCH, SINGLE POLE
- S2 SWITCH, DOUBLE POLE
- S3 SWITCH, THREE WAY
- S4 SWITCH, FOUR WAY
- SK SWITCH, KEY OPERATED
- SP SWITCH, WITH PILOT LIGHT
- SWP SWITCH, WEATHERPROOF
- SX SWITCH, EXPLOSIONPROOF
- SD SWITCH, DIMMER
- STS SWITCH, SPRING WOUND, INTERVAL TIME SWITCH
- SDT SWITCH, DIGITAL INTERVAL TIME SWITCH
- SLV SWITCH, POWER LIMITED LOW VOLTAGE PUSH BUTTON
- LV POWER LIMITED LOW VOLTAGE TOUCHSCREEN LIGHTING CONTROL
- MT MULTI-TECHNOLOGY CEILING OCCUPANCY SENSOR
- US ULTRASONIC CEILING OCCUPANCY SENSOR
- PS PASSIVE INFRARED CEILING OCCUPANCY SENSOR
- WS SINGLE POLE WALL OCCUPANCY SENSOR
- DT TWO POLE WALL OCCUPANCY SENSOR
- COMBINATION WALL OCCUPANCY SENSOR AND DIMMER
- DL DAYLIGHT SENSOR
- TC TIMECLOCK
- PC PHOTOCELL
- PP POWER PACK
- C CONTACTOR
- LCP LIGHTING CONTROL PANEL
- LRP LIGHTING RELAY PANEL
- ALCR AUTOMATIC LOAD CONTROL RELAY (LIGHTING)

FIRE ALARM SYSTEMS

- FACP FIRE ALARM CONTROL PANEL
- FAA FIRE ALARM ANNUNCIATOR
- M MANUAL PULL STATION
- FH FIRE ALARM WALL HORN-STROBE
- FS FIRE ALARM WALL STROBE
- FIRE ALARM CEILING STROBE
- FIRE ALARM CEILING HORN-STROBE
- S FIRE ALARM CEILING SPEAKER
- B FIRE ALARM BELL
- EM ELECTRO-MAGNETIC DOOR HOLDER
- FA FIRE ALARM ADDRESSIBLE INTERFACE DEVICE.
- P PHOTOELECTRIC SMOKE DETECTOR
- D DUCT TYPE SMOKE DETECTOR
- H HEAT DETECTOR
- FS SPRINKLER FLOW SWITCH
- TS SPRINKLER TAMPERSWITCH

GENERAL NOTES:

1. 120 VOLT CIRCUITS SHALL UTILIZE SEPARATE INDEPENDENT NEUTRAL CONDUCTORS. DO NOT SHARE NEUTRALS.
2. CONTRACTOR SHALL COORDINATE WITH ALL TRADES. NO ADDITIONAL COMPENSATION WILL BE ALLOWED FOR INCORRECT WORK, OR FOR INFRINGEMENT UPON OTHERS' WORK, DUE TO A LACK OF COORDINATION.
3. DEVICES IN GENERAL SHALL BE CENTERED IN WALL SPACE IN WHICH THEY ARE INSTALLED OR THEY SHALL BE SPACED SYMMETRICALLY (FOR EXAMPLE, CENTER DEVICES WHEN MOUNTED ON FACE OF COLUMNS).
4. COORDINATE AND VERIFY LOCATIONS OF LIGHT FIXTURES WITH SHOWER ASSEMBLY DRAWINGS.
5. WIRING SHALL BE MINIMUM #12 AWG IN 3/4" EMT CONDUIT UNLESS OTHERWISE NOTED OR REQUIRED.
6. CABLES BEING ROUTED THROUGH AREAS WITH EXPOSED STRUCTURE OR INACCESSIBLE CEILINGS, INSTALL CABLES IN MINIMUM 1-INCH CONDUITS.
7. DEVICE BOXES SHALL BE FLUSH MOUNTED AND RACEWAYS SHALL BE CONCEALED. ROUTE RACEWAYS SO AS TO MINIMIZE THE AMOUNT OF CUTTING AND PATCHING REQUIRED. PATCHING SHALL COMPLY WITH ALL BID DOCUMENT REQUIREMENTS.
8. WHERE SURFACE DEVICE BOXES ARE PERMITTED, DO NOT USE PLASTER RINGS. USE EXPOSED WORK COVERS INTENDED FOR THE PURPOSE.
9. WHERE SURFACE CONDUIT OR EMT IS PERMITTED, DO NOT USE CONDUIT HANGERS LESS THAN 8-FEET AFF. USE ONE- OR TWO-HOLE STRAPS SO THAT NO SHARP EDGES PROTRUDE FROM THE WALL.
10. EXISTING CONCEALED RACEWAYS AND DEVICE BOXES MAY BE REUSED IN PLACE IF DEEMED CODE COMPLIANT AND IN GOOD CONDITION. CONTRACTOR IS RESPONSIBLE FOR VERIFICATION.
11. A MAXIMUM OF THREE SINGLE-PHASE CIRCUITS SHALL BE INSTALLED IN A SINGLE CONDUIT.
12. PROVIDE FIRESTOPPING AT PENETRATIONS THROUGH FIRE-RATED CONSTRUCTION.
13. UNLESS NOTED OTHERWISE, JUNCTION BOXES AND PULL BOXES SHALL BE LISTED AND LABELLED BY A NATIONALLY RECOGNIZED TESTING LABORATORY.

GENERAL NOTES - DEMOLITION:

1. FIELD VERIFY EXISTING CONDITIONS PRIOR TO BEGINNING WORK. THESE DRAWINGS DO NOT SHOW ALL REQUIRED DEMOLITION WORK. SOME CONDITIONS MAY HAVE BEEN CONCEALED DURING FIELD SURVEYS.
2. DEVICES AND EQUIPMENT SHOWN DASHED AND WITH HEAVY LINE WEIGHT ON DEMOLITION DRAWINGS SHALL BE REMOVED IN THEIR ENTIRETY, INCLUDING ALL WIRING TO SOURCE, UNLESS OTHERWISE NOTED.
3. DISPOSAL OF DEMOLISHED MATERIALS SHALL COMPLY WITH LOCAL, STATE, AND FEDERAL REGULATIONS.
4. CONTRACTOR SHALL PROTECT EXISTING OWNER FACILITIES THAT ARE TO REMAIN DURING CONSTRUCTION. ANY FACILITIES DAMAGED OR DISCONNECTED BY CONTRACTOR SHALL BE IMMEDIATELY RESTORED TO PREVIOUS CONDITION.
5. OWNER SHALL HAVE "RIGHT OF FIRST REFUSAL" FOR DEMOLISHED ITEMS. CONTRACTOR SHALL COORDINATE WITH OWNER PRIOR TO BEGINNING WORK TO DETERMINE WHAT ITEMS THE OWNER MAY BE INTERESTED IN KEEPING. CONTRACTOR SHALL CAREFULLY REMOVE SUCH ITEMS AND DELIVER TO OWNER'S DESIGNATED STORAGE AREA. FOR ITEMS DEEMED OBSOLETE BY THE OWNER, CONTRACTOR SHALL IMMEDIATELY REMOVE SUCH ITEMS FROM THE PREMISES, UNLESS OTHERWISE NOTED.
6. FOR EQUIPMENT OR DEVICES BEING REMOVED FROM WALLS THAT WILL REMAIN, REMOVE EXISTING DEVICE BOX AND PATCH WALL, UNLESS OTHERWISE REQUIRED OR INSTRUCTED. FINISH CONDITION SHALL SHOW NO INDICATION OF PREVIOUS INSTALLATION.
7. PROVIDE ADEQUATE SUPPORT FOR EXISTING CABLING/RACEWAYS ABOVE CEILING AS REQUIRED. REMOVE OBSOLETE CABLING, WIRING, RACEWAYS, ETC.
8. REMOVE ASSOCIATED ELECTRICAL FOR ANY EXISTING EQUIPMENT BEING REMOVED BY ANY TRADE. REFER TO ALL DRAWINGS.
9. CONTRACTOR SHALL REMOVE EXISTING DEVICES ON WALLS BEING REMOVED, WHETHER DEVICES ARE SHOWN OR NOT, UNLESS OTHERWISE INSTRUCTED.
10. COORDINATE SCHEDULING OF DEMOLITION WORK WITH OWNER AND TRADES.
11. PATCH EXISTING HOLES THROUGH WALLS AND FLOORS WHERE EXISTING RACEWAYS OR CABLES ARE REMOVED.
12. FOR DEMOLITION OF RECESSED PANELS AND SIMILAR EQUIPMENT, COORDINATE WALL PATCH WITH GENERAL CONTRACTOR PRIOR TO BEGINNING WORK.

TYPICAL MOUNTING HEIGHTS

DEVICE TYPE	HEIGHT
RECEPTACLE OUTLETS (GENERAL), TELEPHONE & DATA OUTLETS	16"
RECEPTACLE OUTLETS ABOVE 30" HIGH COUNTERTOPS, TELEPHONE AND DATA OUTLETS ABOVE 30" COUNTERTOPS	36"
RECEPTACLE OUTLETS ABOVE 34" HIGH COUNTERTOPS, TELEPHONE AND DATA OUTLETS ABOVE 36" COUNTERTOPS	40"
RECEPTACLE OUTLETS ABOVE 36" HIGH COUNTERTOPS, TELEPHONE AND DATA OUTLETS ABOVE 36" COUNTERTOPS	42"
ELEVATOR AND HOISTWAY CONTROL BUTTONS	42" TO CENTER OF DEVICE BOX
CARD READERS, FIRE ALARM STATIONS, PUSH BUTTONS, THERMOSTATS, TOGGLE SWITCHES, WALL INTERCOM STATIONS, WALL TELEPHONE OUTLETS	48" TO TOP OF DEVICE BOX
SPECIAL PURPOSE OUTLETS	WITHIN 72" OF INTENDED USE.
FIRE ALARMS (GONGS, BELLS, HORNS, LIGHTS)	BETWEEN 80" TO BOTTOM OF BOX AND 96" TO TOP OF BOX, OR 6" BELOW CEILING, WHICHEVER IS LOWEST.
WALL LIGHTING OUTLETS	84" TO CENTER OF DEVICE BOX
CLOCKS	97" TO CENTER OF CLOCK, BUT AT LEAST 6" BETWEEN TOP OF CLOCK AND CEILING. ABOVE DOORS CENTER CLOCK BETWEEN TOP OF DOOR FRAME AND CEILING
BELLS, BUZZERS, CHIMES	96" TO CENTER OF DEVICE BOX,BUT AT LEAST 6" BELOW CEILING

NOTES:
1. MOUNTING HEIGHTS ARE TO BOTTOM OF DEVICE BOX UNLESS NOTED OTHERWISE.
2. COMPLY WITH ACCESSIBILITY CODE.

BRANCH CIRCUIT WIRING CHART

FEEDER CONDUCTOR SIZES SHOWN ON THESE BID DOCUMENTS HAVE BEEN SELECTED TO MAINTAIN LESS THAN 2% VOLTAGE DROP AT POTENTIAL FULL LOAD CONDITION (80% OF CIRCUIT SIZE) PER ANTICIPATED ROUTING AND CONDUCTOR LENGTH. BRANCH CIRCUIT CONDUCTORS SHALL BE SIZED TO MAINTAIN LESS THAN 3% VOLTAGE DROP FROM PANELBOARD TO LOAD BASED UPON 60% OF CIRCUIT SIZE LOAD CONDITIONS. THE FOLLOWING CHART REPRESENTS WIRE SIZES FOR A 20 AMP CIRCUIT BASED UPON CIRCUIT LENGTH IN ORDER TO MAINTAIN LESS THAN 3% VOLTAGE DROP FOR A 12 AMP LOAD. CONTRACTOR SHALL USE THIS CHART FOR BIDDING AND INSTALLATION GUIDELINES. FOR KNOWN CIRCUITS WITH LARGER LOAD CONDITIONS, CONTRACTOR SHALL ADJUST ACCORDINGLY. GROUND CONDUCTOR SIZES SHALL BE INCREASED SAME AS CIRCUIT CONDUCTORS, PER NEC. ADJUST RACEWAY SIZES ACCORDINGLY.

BRANCH CIRCUIT CONDUCTOR LENGTH FOR 20 AMP CIRCUIT TO MAINTAIN LESS THAN 3% VOLTAGE DROP AT 12 AMP LOAD. ADJUST AS KNOWN CONDITIONS REQUIRE.

WIRE SIZE	120V-1P	208V-1P	208V-3P	277V-1P	480V-3P
#12	0'-80'	0'-140'	0'-160'	0'-185'	0'-375'
#10	81'-135'	141'-230'	161'-270'	186'-310'	376'-620'
#8	136'-200'	231'-350'	271'-410'	311'-470'	621'-940'
#6	201'-315'	351'-550'	411'-635'	471'-735'	941'-1475'

CONDUCTOR LENGTHS INDICATED ARE TO THE FIRST DEVICE (BUT MAINTAIN MAXIMUM 5% VOLTAGE DROP TO THE LAST DEVICE FOR KNOWN LOADS).

COPYRIGHT © 2026 LUMINAUT, INC. 11/12/2026 8:37:53 AM - Autodesk Docs://Pulaski County Justice Center - Shower Stall Replacement/26069 - Pulaski Justice Center - MEP_r24.rvt

LUMINAUT
1100 Sycamore Street, Suite 200
Cincinnati, Ohio 45202 - Ph: 513.984.1070
702 N. Capitol Avenue
Indianapolis, Indiana 46204
Ph: 317.636.3980
www.luminaut.com

D&A #26069

R.E. Dimond and Associates, Inc.
Consulting Engineers
732 North Capitol Avenue
Indianapolis, IN 46204
Phone: (317) 634-4672
Fax: (317) 638-8725

Project Title
Pulaski County Justice Center - Shower Replacement

110 E. Meridian St.
Winamac, IN 46996

TIMOTHY E. HILL REGISTERED No. PE19800083 STATE OF INDIANA PROFESSIONAL ENGINEER
11/16/2026


Issue Date: November 16, 2026
Issued for: ISSUED FOR BIDDING

Revision
1

Sheet Title
SYMBOLS, ABBREVIATIONS, & GENERAL NOTES - ELECTRICAL


Project No. IN26034
Drawn By: DMH
Reviewed By: TEH
Scale: AS INDICATED

E0.01

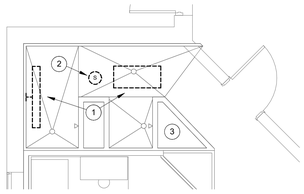


1 NORTHWEST LEVEL 1 - ELECTRICAL DEMOLITION

SCALE: 1/4" = 1'-0"

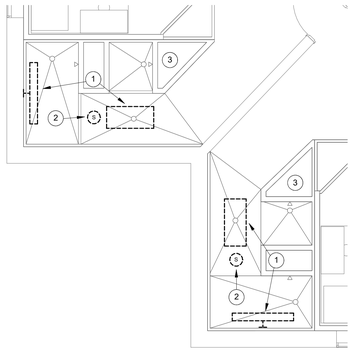


2 SOUTHWEST LEVEL 1 - ELECTRICAL DEMOLITION

SCALE: 1/4" = 1'-0"

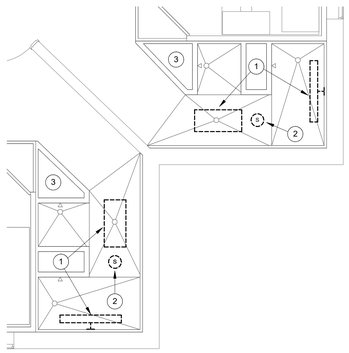

3 SOUTHEAST LEVEL 1 - ELECTRICAL DEMOLITION

SCALE: 1/4" = 1'-0"




4 NORTHEAST LEVEL 1 - ELECTRICAL DEMOLITION

SCALE: 1/4" = 1'-0"



5 ELECTRONIC SHOWER CONTROL MODULES

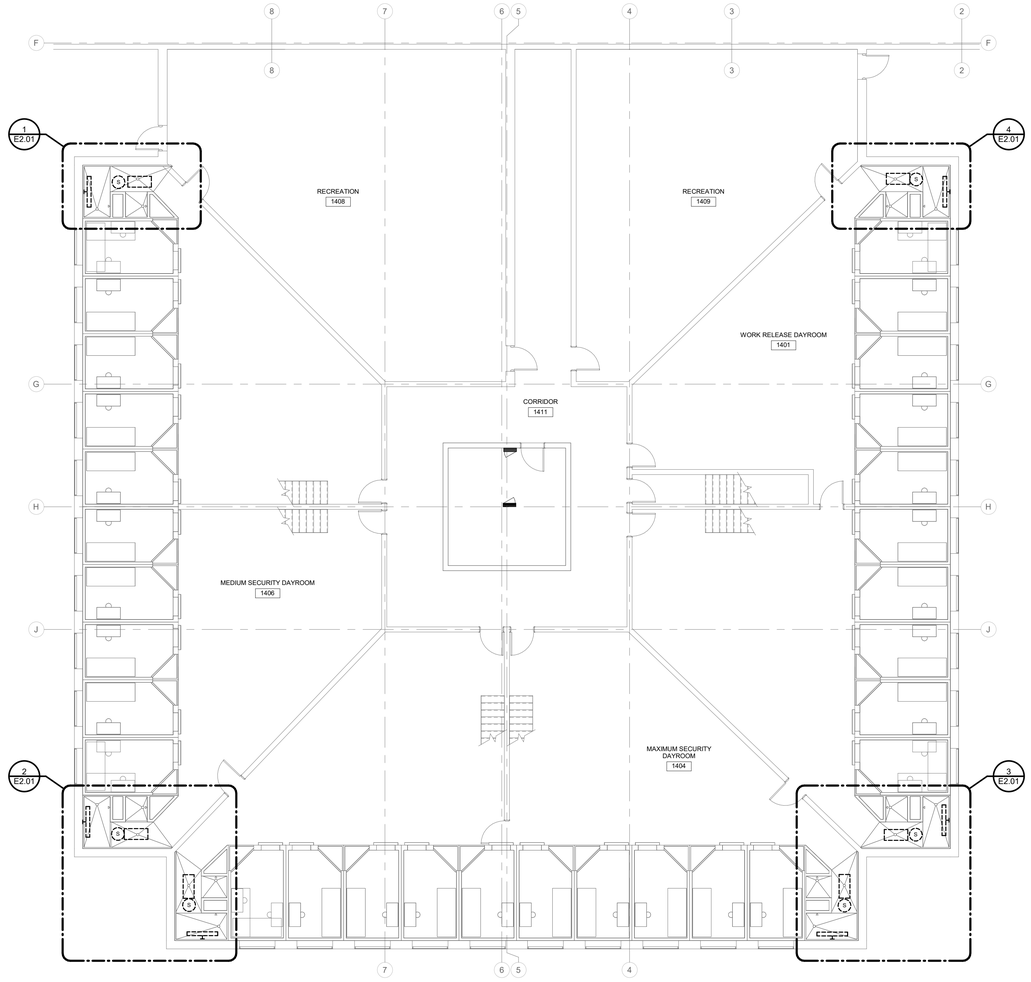

OVERALL LEVEL 1 - ELECTRICAL DEMOLITION

SCALE: 1/8" = 1'-0"

NORTH

DEMOLITION LEGEND:

- WORK TO BE REMOVED
- WORK TO REMAIN

GENERAL NOTES:

1. SEE E0.01 FOR GENERAL NOTES.
2. ELECTRICAL PANELS FEEDING THE EXISTING LIGHT FIXTURES ARE LOCATED IN THE BASEMENT BELOW THE FIRST FLOOR CONTROL ROOM.

(#) PLAN NOTES:

1. REMOVE EXISTING LIGHT FIXTURE AND PROPERLY DISPOSE. PRESERVE EXISTING JUNCTION BOX AND WIRING FOR INSTALLATION OF NEW LIGHT FIXTURES.
2. EXISTING INTERCOM SPEAKER TO BE REMOVED WITH SHOWER ASSEMBLY. EXISTING SPEAKER WIRING TO BE REMOVED BACK TO ITS SOURCE (CONTROL ROOM CONSOLE).
3. UNDER **BASE BID**, SHOWER CONTROL SOLENOIDS (REFER TO PHOTO ON THIS DRAWING) AND ASSOCIATED WIRING TO BE REUSED. SHOWER INSTALLTION CONTRACTOR TO REMOVE CONTROL SOLENOIDS FROM EXISTING ASSEMBLY AND PRESERVE FOR REINSTALLATION. UNDER **ALTERNATE No.1**, E.C. TO REMOVE EXISTING 24VAC CONTROL WIRING FROM CONTROL SOLENOIDS AND PRESERVE FOR RECONNECTION TO NEW CONTROL MODULES PROVIDED WITH NEW SHOWER ASSEMBLY.

LUMINAUT
1100 Sycamore Street, Suite 200
Cincinnati, Ohio 45202 - Ph: 513.984.1070
702 N. Capitol Avenue
Indianapolis, Indiana 46204
Ph: 317.636.3980
www.luminaut.com

D&A #26069
R.E. Dimond and Associates, Inc.
Consulting Engineers
732 North Capitol Avenue
Indianapolis, IN 46204
Phone: (317) 634-4672
Fax: (317) 638-8725

Project Title

Pulaski County Justice Center - Shower Replacement

110 E. Meridian St.
Winamac, IN 46996

TIMOTHY E. HILL REGISTERED No. PE19800083 STATE OF INDIANA PROFESSIONAL ENGINEER
11/16/2026

Issue Date: November 16, 2026

Issued for: ISSUED FOR BIDDING

Revision

1

Sheet Title

LEVEL 1 FLOOR PLANS - ELECTRICAL DEMOLITION

Project No. IN26034


Drawn By: DMH

Reviewed By: TEH

Scale: AS INDICATED


ED2.01

COPYRIGHT © 2022 LUMINAUT, INC. - 11/13/2026 8:37:16 AM - Autodesk Docs://Pulaski County Justice Center_Shower Stall Replacement/IN26069 - Pulaski Justice Center - MEP_v24.rvt




1 NORTHWEST LEVEL 2 - ELECTRICAL DEMOLITION

SCALE: 1/4" = 1'-0"

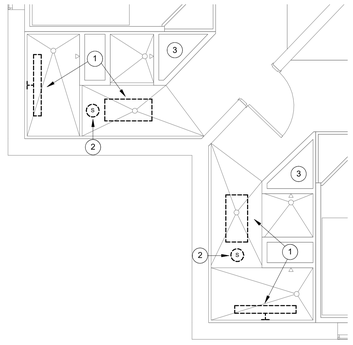


2 SOUTHWEST LEVEL 2 - ELECTRICAL DEMOLITION

SCALE: 1/4" = 1'-0"

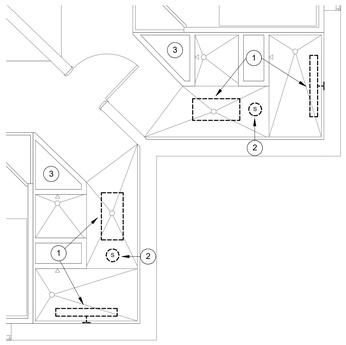


3 SOUTHEAST LEVEL 2 - ELECTRICAL DEMOLITION

SCALE: 1/4" = 1'-0"



4 NORTHEAST LEVEL 2 - ELECTRICAL DEMOLITION

SCALE: 1/4" = 1'-0"

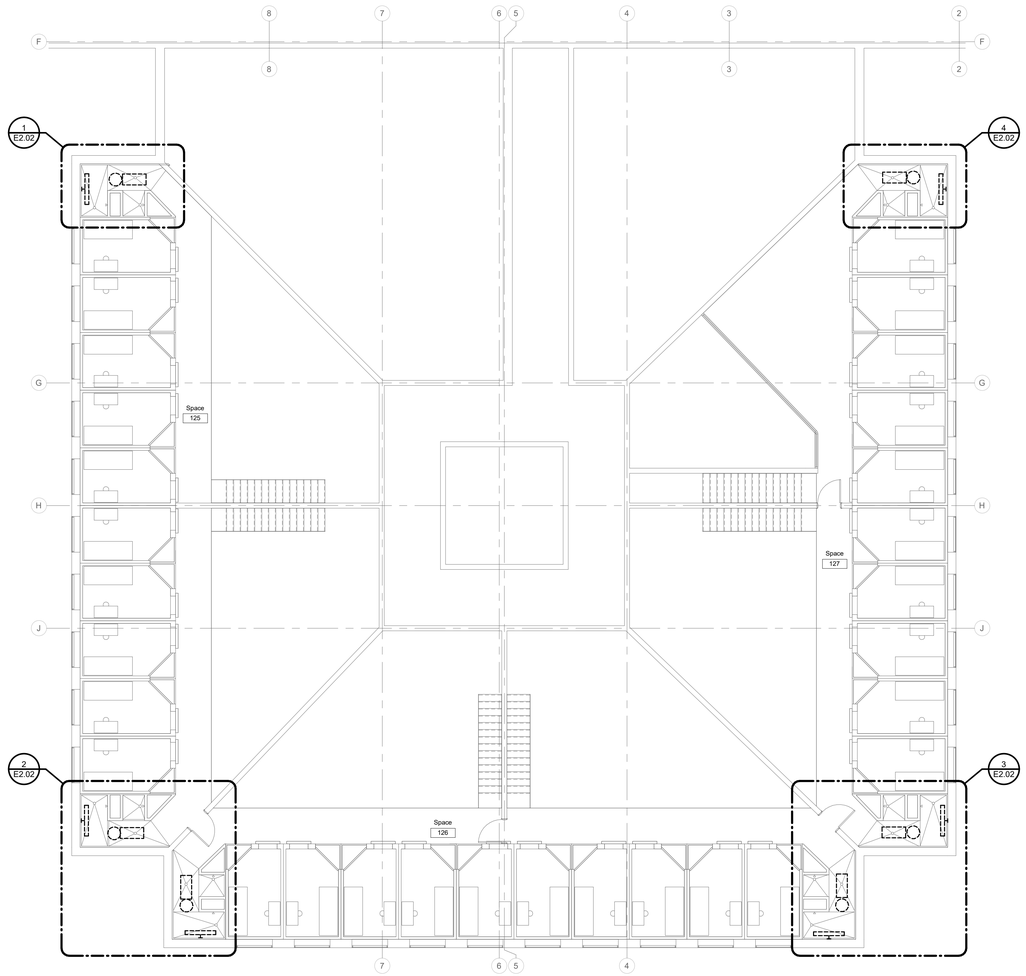

OVERALL LEVEL 2 - ELECTRICAL DEMOLITION

SCALE: 1/8" = 1'-0"

NORTH

DEMOLITION LEGEND:

- WORK TO BE REMOVED
- WORK TO REMAIN

GENERAL NOTES:

1. SEE E0.01 FOR GENERAL NOTES.
2. ELECTRICAL PANELS FEEDING THE EXISTING LIGHT FIXTURES ARE LOCATED IN THE BASEMENT BELOW THE FIRST FLOOR CONTROL ROOM.

(#) PLAN NOTES:

1. REMOVE EXISTING LIGHT FIXTURE AND PROPERLY DISPOSE. PRESERVE EXISTING JUNCTION BOX AND WIRING FOR INSTALLATION OF NEW LIGHT FIXTURES.
2. EXISTING INTERCOM SPEAKER TO BE REMOVED WITH SHOWER ASSEMBLY. EXISTING SPEAKER WIRING TO BE REMOVED BACK TO ITS SOURCE (CONTROL ROOM CONSOLE).
3. UNDER **BASE BID**, SHOWER CONTROL SOLENOIDS (REFER TO PHOTO ON DRAWING ED2.01) AND ASSOCIATED WIRING TO BE REUSED. SHOWER INSTALLTION CONTRACTOR TO REMOVE CONTROL SOLENOIDS FROM EXISTING ASSEMBLY AND PRESERVE FOR REINSTALLATION. UNDER **ALTERNATE No.1**, E.C. TO REMOVE EXISTING 24VAC CONTROL WIRING FROM CONTROL SOLENOIDS AND PRESERVE FOR RECONNECTION TO NEW CONTROL MODULES PROVIDED WITH NEW SHOWER ASSEMBLY.

LUMINAUT

1100 Sycamore Street, Suite 200
Cincinnati, Ohio 45202 - Ph: 513.984.1070

702 N. Capitol Avenue
Indianapolis, Indiana 46204
Ph: 317.636.3980

www.luminaut.com

D&A #26069

R.E. Dimond and Associates, Inc.
Consulting Engineers
732 North Capitol Avenue
Indianapolis, IN 46204
Phone: (317) 634-4672
Fax: (317) 638-8725

Project Title

Pulaski County Justice Center - Shower Replacement

110 E. Meridian St.
Winamac, IN 46996

TIMOTHY E. HILL REGISTERED No. PE19800083 STATE OF INDIANA PROFESSIONAL ENGINEER
11/16/2026

Issue Date: November 16, 2026

Issued for: ISSUED FOR BIDDING

Revision
1

Sheet Title
LEVEL 2 FLOOR PLANS - ELECTRICAL DEMOLITION

Project No. **IN26034**


Drawn By: DMH

Reviewed By: TEH

Scale: AS INDICATED


ED2.02

COPYRIGHT © 2021 LUMINAUT, INC. - 11/12/2026 8:37:57 AM - Autodesk Docs://Pulaski County Justice Center_Shower Stall Replacement/IN26069 - Pulaski Justice Center_MEP_r24.rvt

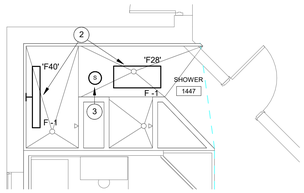


1 NORTHWEST LEVEL 1 - ELECTRICAL

SCALE: 1/4" = 1'-0"

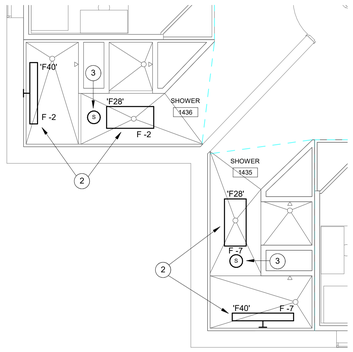


2 SOUTHWEST LEVEL 1 - ELECTRICAL

SCALE: 1/4" = 1'-0"

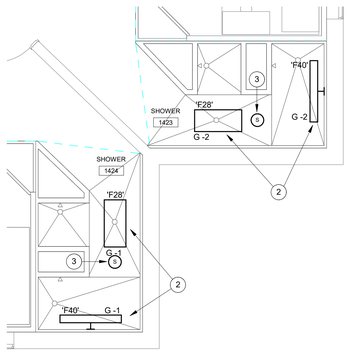


3 SOUTHEAST LEVEL 1 - ELECTRICAL

SCALE: 1/4" = 1'-0"




4 NORTHEAST LEVEL 1 - ELECTRICAL

SCALE: 1/4" = 1'-0"



5 ELECTRICAL CHASE CONDUITS

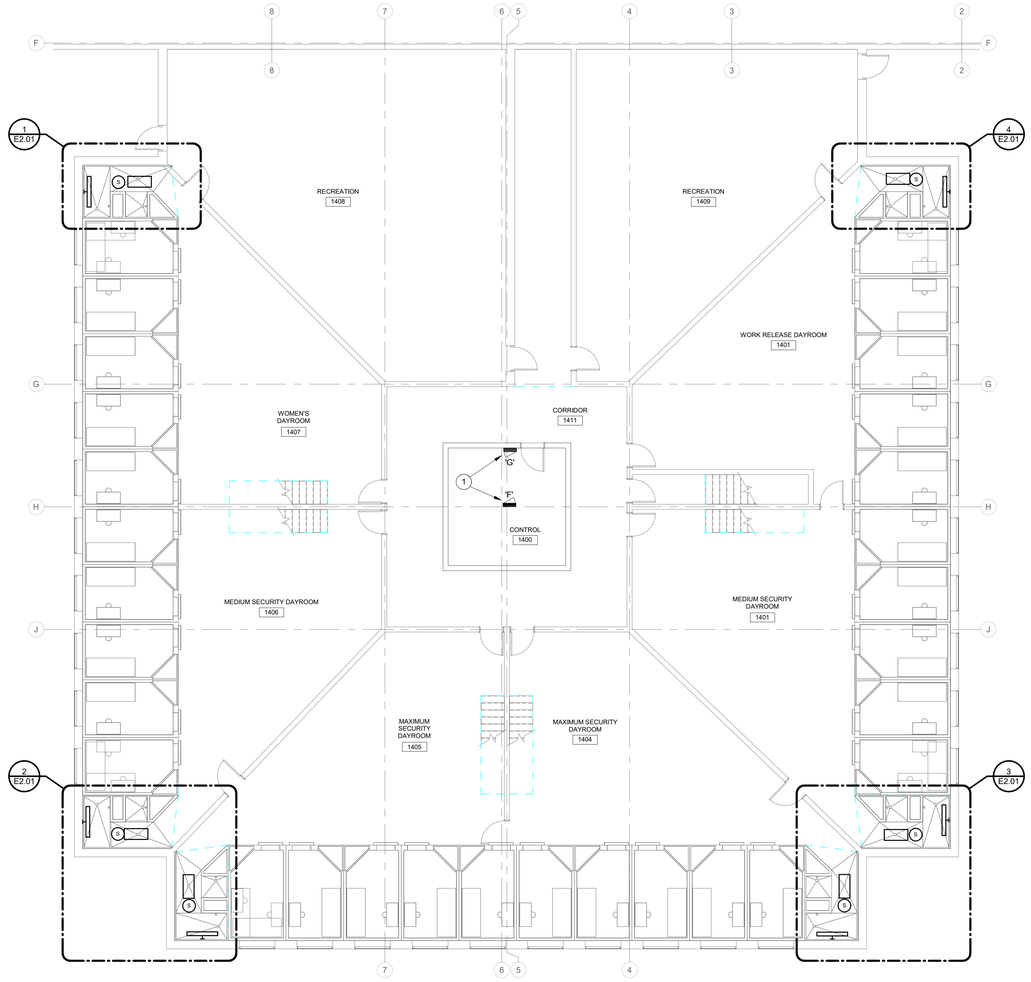

OVERALL LEVEL 1 - ELECTRICAL

NORTH

SCALE: 1/8" = 1'-0"

RENOVATION LEGEND:

WORK TO BE INSTALLED

WORK TO REMAIN

GENERAL NOTES:

1. SEE E0.01 FOR GENERAL NOTES.
2. LIGHT FIXTURES 'F28' AND 'F40' TO BE PROVIDED BY OWNER, INSTALLED BY ELECTRICAL CONTRACTOR. SHOWER STALL INTEGRATER TO TEST FIXTURES PRIOR TO DELIVERING TO ELECTRICAL CONTRACTOR FOR INSTALLATION. REUSE EXISTING LIGHTING/CONTROL CIRCUITS FED FROM EXISTING PANELS 'F' AND 'G'.

(#) PLAN NOTES:

1. EXISTING PANELS 'F' AND 'G' ARE LOCATED IN BASEMENT LEVEL BELOW THE CONTROL ROOM.
2. PRE-FABBED SHOWER STALLS TO BE EQUIPPED WITH JUNCTION BOXES FOR LIGHT FIXTURE WIRING CONNECTIONS.
3. UNDER ADD ALTERNATE No.2, PROVIDE/INSTALL QUAM-NICHOLS RECESSED, VANDAL RESISTANT, LOUDSPEAKER WITH SQUARE, STAINLESS STEEL BAFFLE. MODEL No. H16/SVPS. USE #8-32 'PIN-IN-TORX' MOUNTING SCREWS. PROVIDE NEW 18AWG, TWISTED SHIELDED PAIR (TSP) CABLE (WEST PENN WIRE #293) FROM SPEAKER TO SOUND RACK LOCATED IN CONTROL ROOM. REUSE EXISTING PATHWAY.

LUMINAUT

1100 Sycamore Street, Suite 200
Cincinnati, Ohio 45202 - Ph: 513.984.1070

702 N. Capitol Avenue
Indianapolis, Indiana 46204
Ph: 317.636.3980

www.luminaut.com

D&A #26069

R.E. Dimond and Associates, Inc.
Consulting Engineers
732 North Capitol Avenue
Indianapolis, IN 46204
Phone: (317) 634-4672
Fax: (317) 638-8725

Project Title

Pulaski County Justice Center - Shower Replacement

110 E. Meridian St.
Winamac, IN 46996

TIMOTHY E. HILL
REGISTERED
No. PE19800083
STATE OF INDIANA
PROFESSIONAL ENGINEER

11/16/2026

Issue Date: November 16, 2026

Issued for: ISSUED FOR BIDDING

Revision

1

Sheet Title

LEVEL 1 FLOOR PLANS - ELECTRICAL

Project No. IN26034


Drawn By: DMH

Reviewed By: TEH

Scale: AS INDICATED


E2.01

COPYRIGHT © 2022 LUMINAUT, INC. - 11/13/2026 8:38:00 AM - Autodesk Docs://Pulaski County Justice Center_Shower Stall Replacement/25099 - Pulaski Justice Center - MEP_v24.rvt




1 NORTHWEST LEVEL 2 - ELECTRICAL

SCALE: 1/4" = 1'-0"

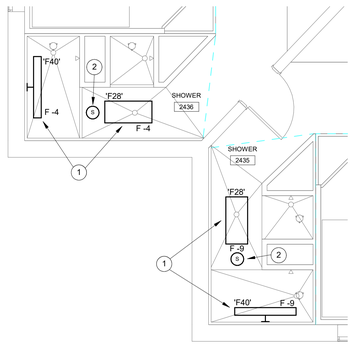


2 SOUTHWEST LEVEL 2 - ELECTRICAL

SCALE: 1/4" = 1'-0"

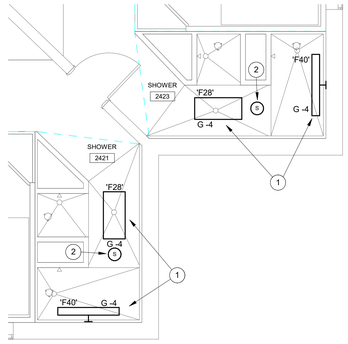


3 SOUTHEAST LEVEL 2 - ELECTRICAL

SCALE: 1/4" = 1'-0"



4 NORTHEAST LEVEL 2 - ELECTRICAL

SCALE: 1/4" = 1'-0"

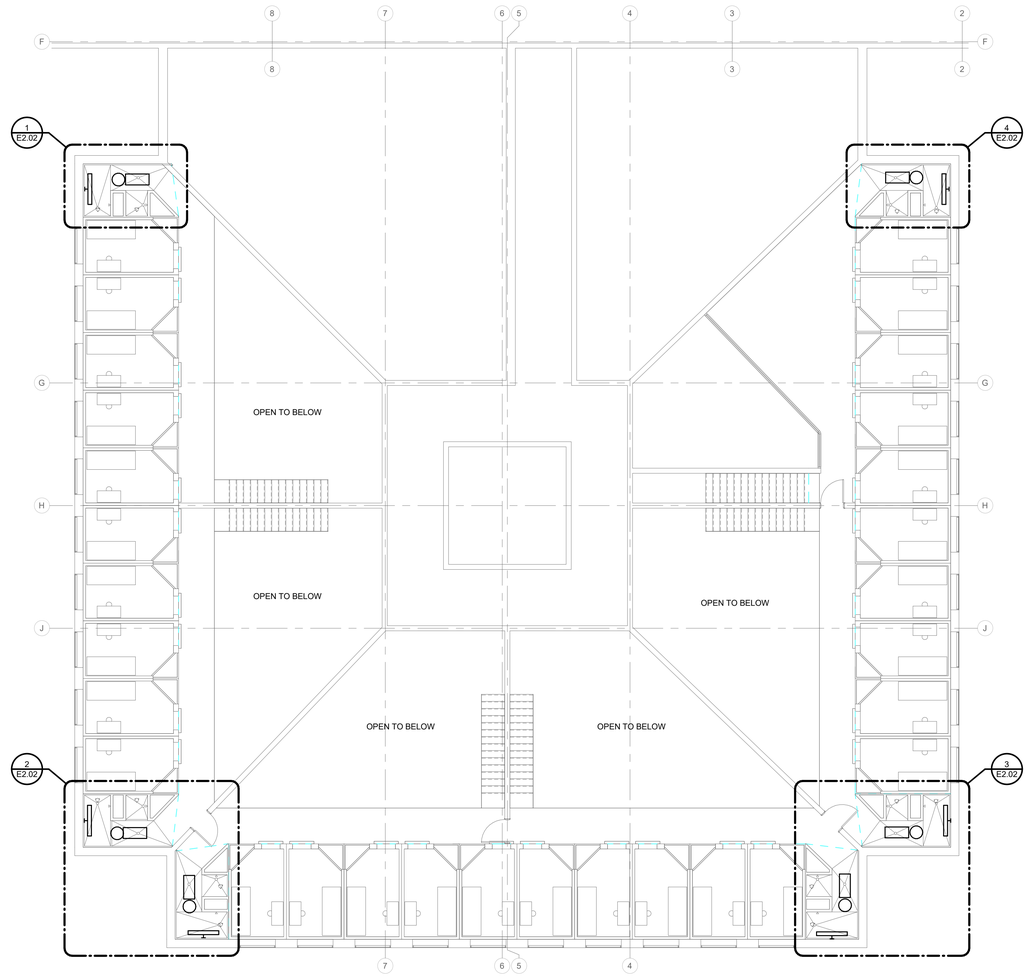

OVERALL LEVEL 2 - ELECTRICAL

SCALE: 1/8" = 1'-0"

NORTH

RENOVATION LEGEND:

- WORK TO BE INSTALLED
- WORK TO REMAIN

GENERAL NOTES:

1. SEE E0.01 FOR GENERAL NOTES.
2. LIGHT FIXTURES 'F28' AND 'F40' TO BE PROVIDED BY OWNER, INSTALLED BY ELECTRICAL CONTRACTOR.
3. PANELS 'F' AND 'G' ARE LOCATED IN THE BASEMENT LEVEL BELOW THE FIRST FLOOR CONTROL ROOM.

(#) PLAN NOTES:

1. PRE-FABBED SHOWER STALLS TO BE EQUIPPED WITH JUNCTION BOXES FOR LIGHT FIXTURE WIRING CONNECTIONS.
2. PROVIDE/INSTALL QUAM-NICHOLS RECESSED, VANDAL RESISTANT, LOUDSPEAKER WITH SQUARE, STAINLESS STEEL BAFFLE. MODEL No. H16/SVPS. USE #8-32 'PIN-IN-TORX' MOUNTING SCREWS. PROVIDE NEW 18AWG, TWISTED SHIELDED PAIR (TSP) CABLE (WEST PENN WIRE #293) FROM SPEAKER TO SOUND RACK LOCATED IN CONTROL ROOM. REUSE EXISTING PATHWAY.

LUMINAUT

1100 Sycamore Street, Suite 200
Cincinnati, Ohio 45202 - Ph: 513.984.1070

702 N. Capitol Avenue
Indianapolis, Indiana 46204
Ph: 317.636.3980

www.luminaut.com

D&A #26069

R.E. Dimond and Associates, Inc.
Consulting Engineers
732 North Capitol Avenue
Indianapolis, IN 46204
Phone: (317) 634-4672
Fax: (317) 638-8725

Project Title

Pulaski County Justice Center - Shower Replacement

110 E. Meridian St.
Winamac, IN 46996

TIMOTHY E. HILL REGISTERED No. PE19800083 STATE OF INDIANA PROFESSIONAL ENGINEER

11/16/2026

Issue Date: November 16, 2026

Issued for: ISSUED FOR BIDDING

Revision

1

Sheet Title

LEVEL 2 FLOOR PLANS - ELECTRICAL

Project No. IN26034

Drawn By: DMH

Reviewed By: TEH

Scale: AS INDICATED

E2.02

COPYRIGHT © 2021 LUMINAUT, INC. - 11/12/2026 8:38:03 AM - Autodesk Docs://Pulaski County Justice Center_Shower Stall Replacement/26069 - Pulaski Justice Center_MEP_r24.rvt